



Patent



ISO9001



ISO14001



ISO45001



CE



K-mark




High Efficiency



KARSE

# World EnC Absorption Chiller

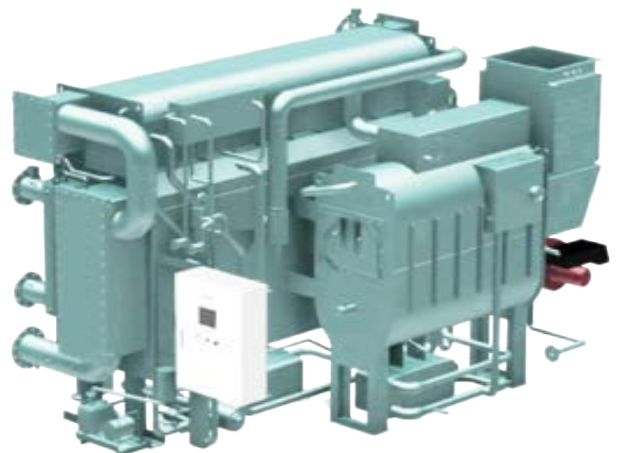

Creating Value For The Customer  
Through The Absorption Technology



# World EnC Co.,Ltd.

THE BEST SOLUTION FOR  
ABSORPTION CHILLER

# CONTENTS

- Company History ..... 05
- Direct Fired Absorption Chiller & Heater ..... 06
- Double Lift Hot Water Absorption Chiller ..... 14
- Double Stage Hot Water Absorption Chiller ..... 18
- Hot Water Absorption Chiller ..... 20
- Steam Fired Absorption Chiller ..... 23
- Exhaust Gas Absorption Chiller & Heater ..... 26
- Multi-Fuel Absorption ..... 30
- Heat Pump ..... 32
- Control System ..... 34
- Field Installed ..... 35



By Continuing challenge  
We will open the eco-friendly future

# By continuing challenge, We will open the eco-friendly future.

## World EnC Absorption Chiller

We challenge, innovate and strive to satisfy our customers with the best value by providing the most pleasant environment and happiness for the mankind based on our accumulated technology. The company being advanced backed up by customer's encouragement and trust.

The company always seeking innovation with the sense of responsibility and future-oriented mind. We commit ourselves to taking our full responsibility as a new leader of the future energy industry based on the best quality and the latest technology.




CE Certificate



ISO 14001  
Environmental Management



High Efficiency  
Energy Equipment

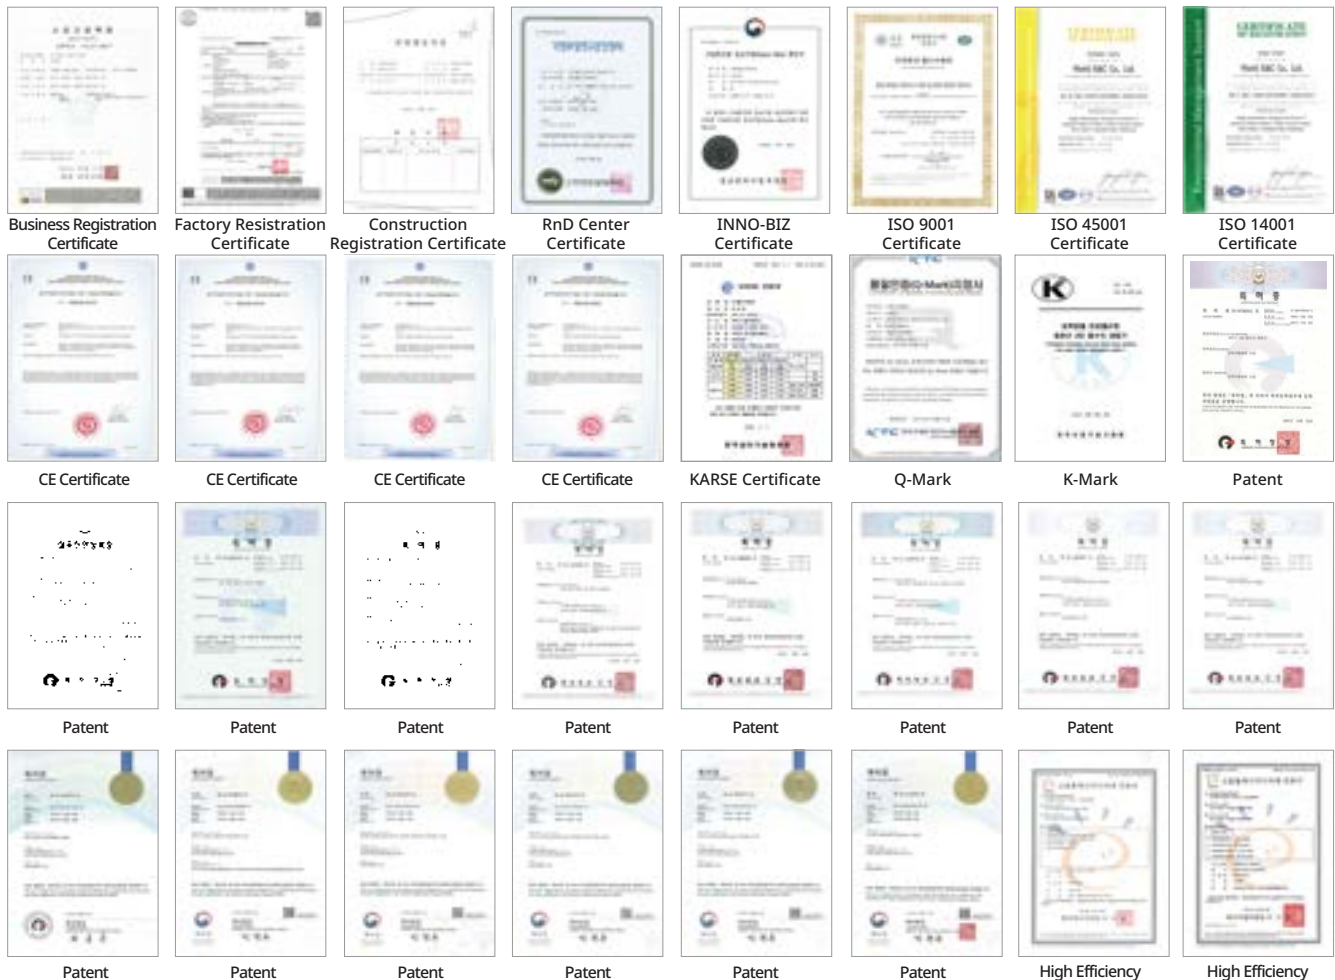


## Brief History

2023	Development Oil-Free Centrifugal Chiller : Danfoss/Turbocor Compressor 2-3 comp (200~600RT)
2022	Development Oil-Free Centrifugal Chiller : Danfoss/Turbocor Compressor 1 comp (80~200RT)
2021	Acquired 3 patents for vapor compression chiller (Flooded evaporator, high efficiency condenser, oil recovery function)
2020	Begin to development of vacuum hot water boiler
2019	Acquired high efficiency Certi. of Screw Chiller (Water cooled-134a)
2018	Initiate development of High Efficiency Screw Chiller
2017	Initiate national project of development of Heat Pump and transformer Initiate national project of development of Absorption Chiller
2016	Certificate of Designation of Excellent Product by Public Procurement Service Registration of Direct Fired Absorption Chiller&Heater in Korea Public Procurement Agency Certificate of green technology (Double Lift Hot water Driven Absorption Chiller) Certificate of high efficiency energy material (Double Lift Hot water Driven Absorption Chiller) New business for Screw chiller and Absorption heat pump
2015	Start to develop absorption heat pump for nation project Development of Air Handling Unit (AHU) for exhaust heat recovery
2014	Registration Air Handling Unit in Public Procurement Agency CE : Double-Effect Direct Fired Absorption Chiller&Heater Single-Effect Double Lift Hot water Driven Absorption Chiller (WDL 75~975 Series)
2013	Certificate ISO 14001 Build a new factory for Air Handling Unit(AHU)
2011	Development of High-efficiency Direct Fired Absorption chiller&heater (COP 1.36, 1.51(LHV))
2010	Resigtration of Double Lift Hot water Driven Absorption Chiller as excellent product by Korea Public Procure Agency
2009	Development of exhaust gas absorption chiller-heater
2007	Registration of patent (Double Lift Hot water Driven Absorption Chiller)
2006	Development of Double Lift Hot water Absorption Chiller Development of Single Effect Hot water Driven Absorption Chiller Certificate INNO BIZ by SMBA
2005	Registration license of making specific facility, Certificate of venture company Establish research affiliated with World E&C (Korea industrial technology promotion association)
2001-2003	Certificate ISO 9001 / 9002
1999	Business for high temperature generator in Direct Fired Absorption Chiller&Heater Establish World EnC



# Direct Fired Absorption Chiller & Heater

50RT ~ 1500RT 29 Models

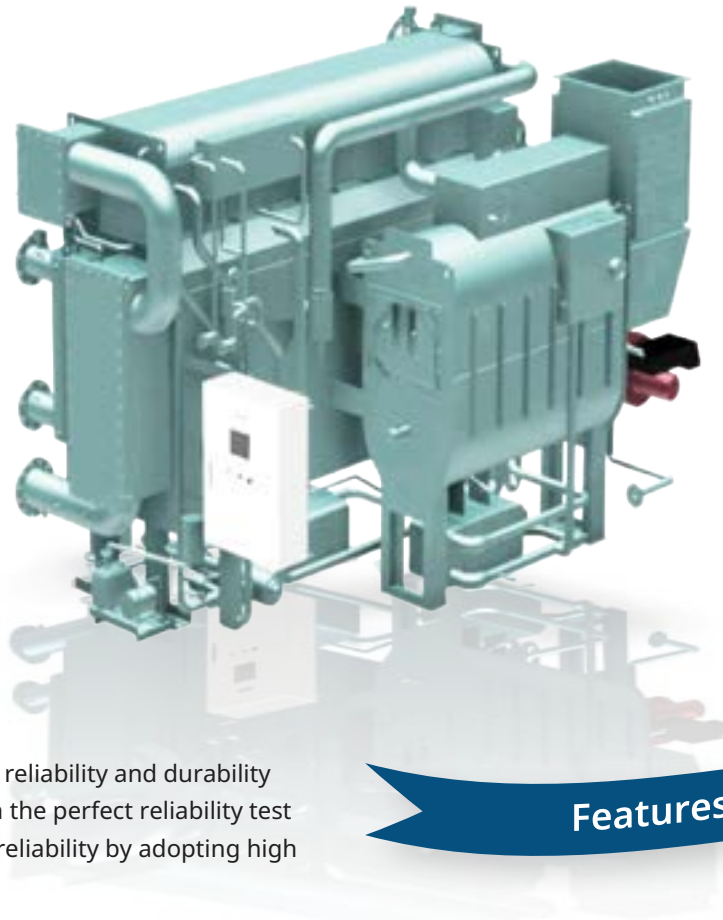

CE



Patent

## 1. High reliability

- Designed to enhance the reliability and durability
- Robust structure through the perfect reliability test for long time and higher reliability by adopting high quality components

## 2. Efficient operation

- Energy saving and efficiency realized
- Optimal control for the solution cycling volume by inverter depending on the cooling load
- Optimal PID control by sensing the operating condition with the level sensor
- Minimized power consumption due to precise operation and partial load operation  
[Option] Early reduction, Anti-freezing, Refrigerant generation, Solution refining, Tube ball clean, Crystal forming prevention from power failure

## 3. Convenient partition

- Repair and maintenance is easy. Multi-partition structure
- Mounting/detaching structure for easy repair and maintenance
- Partial incoming to make it possible for field work such as remodeling at narrow space. Assembling at field is possible.

## 4. Low noise and low vibration

- Below 75dB at 1m distance for noise level

## Features of WDA Series

## 5. Perfect vacuum

- High performance & purge system.  
Cost-efficiency for maintenance
- Leakage for one month at below 3cc.  
High vacuum condition
- Auto purge. / Non-condensing gas storage
- Maintaining optimal operating condition.  
Operation with only minimum steam extraction.

## 6. Enough capacity

- Heating capacity increase system
- Designed to increase up to 3 stages from the standard.


## 7. Latest operation

- Latest PLC, remote control and BAS compatible
- Increase chiller's efficiency with precise PID control
- Applicable for Modbus, Ethernet, BAC Net TCP/IP
- 10 inch touch screen and possible for VNC communication
- Chiller's status can be monitored through PLC Web connection (Option)


# CYCLE DIAGRAM

## Direct Fired Absorption Chiller & Heater

### Cooling Cycle Diagram

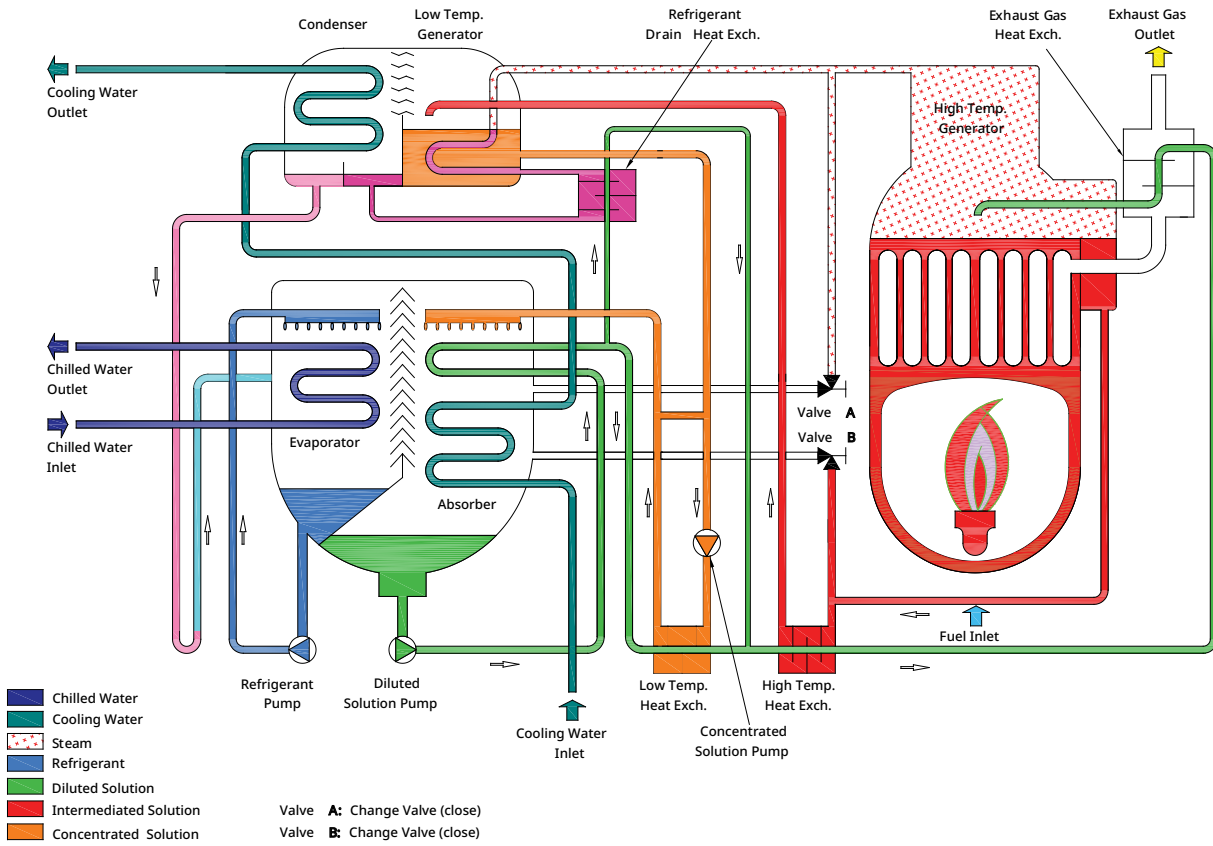

### Heating Cycle Diagram

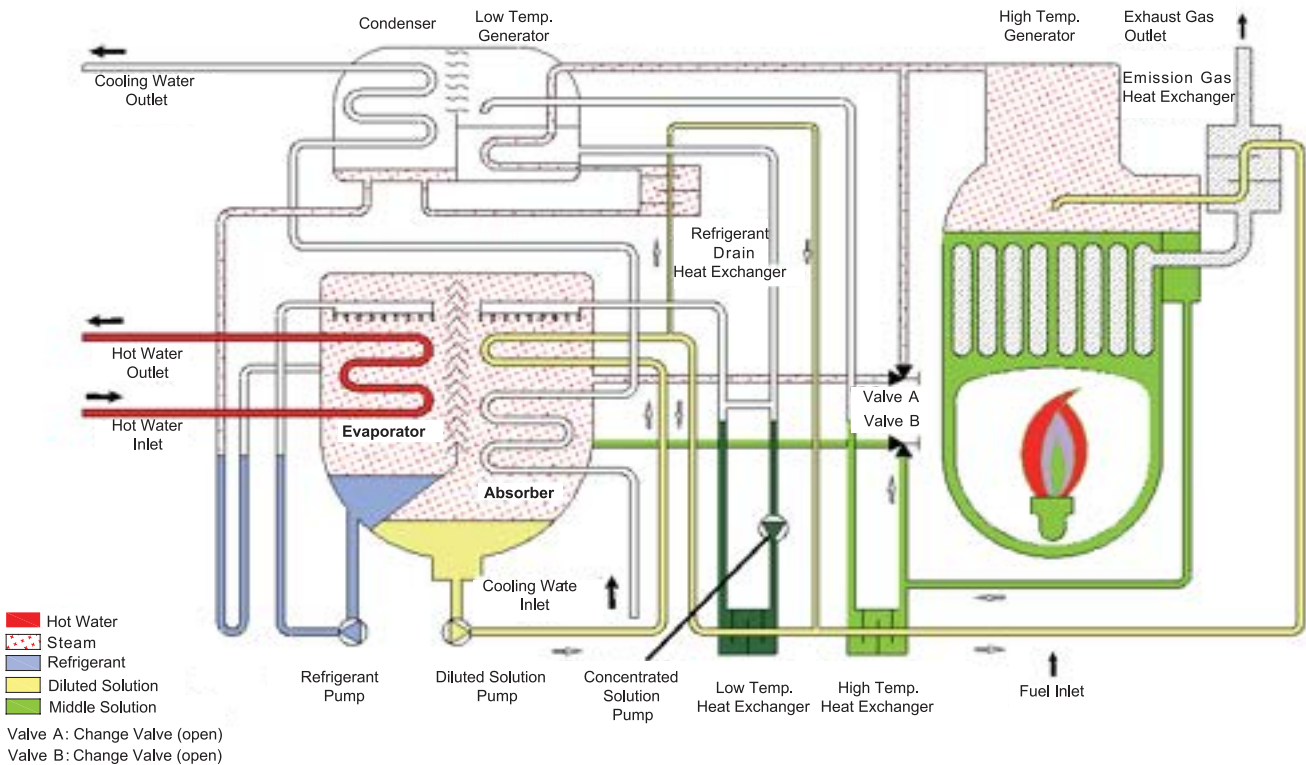

# SPECIFICATION [WDA Series]

## Direct Fired Absorption Chiller & Heater

### COP 1.1(LHV)

MODEL		UNIT	WDA 005	WDA 006	WDA 007	WDA 008	WDA 010	WDA 012	WDA 015	WDA 018	WDA 021	WDA 024	WDA 028	WDA 032	WDA 036	WDA 040		
Cooling capacity	usRT		50	60	70	80	100	120	150	180	210	240	280	320	360	400		
	kW		176	211	246	281	352	422	528	633	739	844	985	1,125	1,266	1,407		
Heating Capacity	Mcal/h		151	181	212	242	302	363	454	544	635	726	847	968	1,089	1,210		
	kW		176	211	246	281	352	422	528	633	739	844	985	1,125	1,266	1,407		
Chilled & Hot Water	Temp. (inlet/outlet)	°C	12/7 (Heating 55 / 60°C)															
	Flow rate	m³/h	30,2	36,3	42,3	48,4	60,5	72,6	90,7	108,9	127,0	145,2	169,3	193,5	217,7	241,9		
	P.Drop	mAq	7,6	7,7	5,8	5,4	5,9	6,0	8,0	8,1	7,5	7,4	5,3	5,2	5,7	5,9		
	Connection	mm	80				100				125				150			
Cooling Water	Temp. (inlet/outlet)	°C	32/37															
	Flow rate	m³/h	50	60	70	80	100	120	150	180	210	240	280	320	360	400		
	P.Drop	mAq	3,5	3,7	8,2	7,7	3,3	3,5	9,6	10,1	5,8	4,7	8,7	8,8	8,9	8,8		
	Connection	mm	100				125				150				200			
Fuel	Gas	Cooling	Nm³/h	15,9	19,1	22,3	25,5	31,8	38,2	47,7	57,3	66,8	76,4	89,1	101,9	114,6	127,3	
		Heating	Nm³/h	18,9	22,7	26,5	30,2	37,8	45,4	56,7	68,0	79,4	90,7	105,9	121,0	136,1	151,2	
		Connection	mm	40 (4,000mAq)														
	Oil	Cooling	kg/h	16,4	19,7	23,0	26,3	32,9	39,4	49,3	59,2	69,0	78,9	92,0	105,2	118,3	131,5	
		Heating	kg/h	19,5	23,4	27,3	31,2	39,0	46,8	58,6	70,3	82,0	93,7	109,3	124,9	140,5	156,1	
		Connection	mm	10				15				20						
Electric	Power Source	-	3Φ, 400V, 50Hz															
	Abs. Pump No.1	kW(A)	1,2(4,0)				2,0(6,0)				2,4(7,5)				3,0(11,0)		3,4(10,2)	
	Abs. Pump No.2	kW(A)	0,3(1,6)				0,4(1,6)				1,2(4,5)				1,5(5,0)			
	Ref. Pump	kW(A)	0,2(1,1)				0,3(1,5)				0,4(1,5)							
	Purge Pump	kW(A)	0,4(1,4)															
	Burner Blower	kW(A)	0,37(1,0)		0,75(2,1)				1,5(4,0)				2,2(5,0)		3,0(6,5)			
	Oil Pump	kW(A)	-				0,24(0,6)				0,55(2,1)							
	Control Panel	kW(A)	0,2(0,5)															
	Total Amp.	Gas	kW(A)	2,67 (9,6)		3,05 (10,7)		4,05 (13,1)		4,8(15,0)		6,1 (19,4)		7,4 (23,9)		8,1(23,6)	8,9(25,1)	
Oil		kW(A)	2,67 (9,6)		3,05 (10,7)		4,29 (13,7)		5,35(17,1)		19,95 (21,5)		7,95 (26,0)		8,65(25,7)	9,45(27,2)		
Size	Length(L)	mm	2,630		2,700		2,853		3,644		3,696		4,782		4,867			
	Width(W)	mm	1,840		1,840		1,940		2,051		2,102		2,200		2,287			
	Height(H)	mm	1,910				2,020				2,390				2,585			
Weight	Rigging	Ton	2,7	2,9	3,1	3,5	3,8	4,0	4,9	5,3	6,1	7,2	7,7	8,3	10,3	10,5		
	Operation	Ton	3,0	3,2	3,4	3,8	4,6	4,8	5,8	6,4	7,5	7,8	8,7	9,3	11,7	12,1		
Space for Tube Replacement	mm	2,000		2,400				3,400				4,600						

- Remark**
- 1) 1usRT = 3,024 kcal/h
  - 2) Working Pressure of each water side is based on 1.0MPa [151psig]
  - 3) Natural Gas LHV(Lower Heating Value) : 9,500kcal/Nm<sup>3</sup>, Diesel Oil LHV(Lower Heating Value) : 9,200kcal/kg
  - 4) Fouling factor 0.0001m<sup>2</sup>·h·°C/kcal for Absorber and Condenser, 0.0001m<sup>2</sup>·h·°C/kcal for Evaporator.
  - 5) Catalogue specifications are subject to change without prior notice.



MODEL		UNIT	WDA 045	WDA 050	WDA 056	WDA 063	WDA 070	WDA 080	WDA 090	WDA 100	WDA 110	WDA 120	WDA 130	WDA 140	WDA 150	
Cooling capacity	usRT		450	500	560	630	700	800	900	1,000	1,100	1,200	1,300	1,400	1,500	
	kW		1,583	1,758	1,969	2,216	2,462	2,814	3,165	3,517	3,869	4,220	4,572	4,924	5,275	
Heating Capacity	Mcal/h		1,361	1,512	1,693	1,905	2,117	2,032	2,286	2,540	2,794	3,048	3,302	3,556	3,810	
	kW		1,583	1,758	1,969	2,216	2,462	2,363	2,659	2,954	3,250	3,545	3,840	4,136	4,431	
Chilled & Hot Water	Temp. (inlet/outlet)	°C	12/7 (Heating 55 / 60°C)													
	Flow rate	m³/h	272.2	302.4	338.7	381.0	423.4	483.8	544.3	604.8	665.3	725.8	786.2	846.7	907.2	
	P.Drop	mAq	5,1	5,3	4,2	5,7	7,6	5,5	7,4	9,7	7,4	9,4	11,7	9,4	11,5	
	Connection	mm	200				250				300				350	
Cooling Water	Temp. (inlet/outlet)	°C	32/37													
	Flow rate	m³/h	450	500	560	630	700	800	900	1,000	1,100	1,200	1,300	1,400	1,500	
	P.Drop	mAq	8,6	8,7	6,4	8,8	11,7	9,1	12,3	16,2	12,3	15,7	7,2	12,8	15,7	
	Connection	mm	250			300			350			400				
Fuel	Gas	Cooling	Nm³/h	143,2	159,2	178,3	200,5	222,8	254,7	286,5	318,3	350,1	382,0	413,8	445,6	477,5
		Heating	Nm³/h	170,1	189,0	211,7	238,2	264,6	254,0	285,8	317,6	349,3	381,1	412,8	444,6	476,3
		Connection	mm	50 (4,000mmAq)						65 (4,000mmAq)						
	Oil	Cooling	kg/h	147,9	164,3	184,1	207,1	230,1	263,0	295,8	328,7	361,6	394,4	427,3	460,2	493,0
		Heating	kg/h	175,7	195,2	218,6	245,9	273,3	262,3	295,1	327,9	360,7	393,5	426,3	459,1	491,9
		Connection	mm	20					25							
Electric	Power Source		3Φ, 400V, 50Hz													
	Abs. Pump No.1	kW(A)	3,4 (10,2)		5,5 (14,5)			6,6 (16,2)			7,5 (25,0)					
	Abs. Pump No.2	kW(A)	1,5 (5,0)		2,0 (6,0)			2,2 (7,0)			4,5 (16,0)					
	Ref. Pump	kW(A)	0,4 (1,5)						1,5 (4,0)							
	Purge Pump	kW(A)	0,4 (1,4)													
	Burner Blower	kW(A)	3,0 (6,5)		5,5 (13,0)			7,5 (15,8)			11,0 (22,7)					
	Oil Pump	kW(A)	0,55 (2,1)						1,1 (4,0)							
	Control Panel	kW(A)	0,2 (0,5)													
	Total Amp.	Gas	kW(A)	8,9 (25,1)		14 (36,9)			18,4 (44,9)			25,1 (69,6)				
	Oil	kW(A)	9,45 (27,2)		14,55 (39,0)			19,5 (48,9)			26,2 (73,6)					
Size	Length(L)	mm	4,880	4,960	5,100	5,600	6,150	5,750	6,250	6,800	6,200	6,700	7,200	6,900	7,400	
	Width(W)	mm	2,550		3,150			3,400			4,210			4,630		
	Height(H)	mm	2,800		3,300			3,600			3,600			3,800		
Weight	Rigging	Ton	12,6	12,8	18,1	19,6	21,0	27,9	30,2	32,6	37,8	40,7	43,2	47,5	50,0	
	Operation	Ton	14,5	14,8	20,7	22,3	24,0	31,8	34,3	37,0	42,1	45,2	48,1	52,7	55,6	
Space for Tube Replacement	mm	4,600			5,200	5,700	5,200	5,700	6,200	5,700	6,200	6,700	6,200	6,700		

# SPECIFICATION [WDA-E Series]

## Direct Fired Absorption Chiller & Heater

### COP 1.36(LHV) Middle-efficiency model

Model		Unit	WDAE 005	WDAE 006	WDAE 007	WDAE 008	WDAE 010	WDAE 012	WDAE 015	WDAE 018	WDAE 021	WDAE 024	WDAE 028	
Cooling capacity	usRT		50	60	70	80	100	120	150	180	210	240	280	
	kW		176	211	246	281	352	422	527	633	738	844	984	
Heating Capacity	Mcal/h		133	159	186	212	265	318	398	477	557	636	742	
	kW		155	185	216	247	308	370	463	555	648	740	863	
Chilled & Hot Water	Temp. (inlet/outlet)	°C	12 / 7 (Heating 55.6 / 60 °C)											
	Flow rate	ton/h	30.2	36.3	42.3	48.4	60.5	72.6	90.7	108.9	127.0	145.2	169.3	
	P. Drop	mAq	7.6	7.7	5.8	5.4	5.9	6.0	8.0	8.1	7.5	7.4	5.3	
	Connection	mm	80				100				125		150	
Cooling Water	Temp. (inlet/outlet)	°C	32 / 37											
	Flow rate	m <sup>3</sup> /h	50	60	70	80	100	120	150	180	210	240	280	
	P. Drop	mAq	3.5	3.7	8.2	7.7	3.3	3.5	9.6	10.1	5.8	4.7	8.7	
	Connection	mm	100				125				150		200	
Fuel	Gas	Cooling	Nm <sup>3</sup> /h	12.1	14.5	17.0	19.4	24.2	29.1	36.3	43.6	50.9	58.2	67.8
		Heating	Nm <sup>3</sup> /h	15.2	18.2	21.2	24.2	30.3	36.3	45.5	54.5	63.6	72.6	84.7
	Connection	mm	40 (4,000mAq)											
Fuel	Oil	Cooling	kg/h	16.4	19.7	23.0	26.3	32.9	39.4	49.3	59.2	69.0	78.9	92.0
		Heating	kg/h	19.5	23.4	27.3	31.2	39.0	46.8	58.6	70.3	82.0	93.7	109.3
	Connection	mm	10				15				20			
Electric	Power Source		3φ 400V 50Hz											
	Abs. Pump No.1	kW(A)	1.2(4.0)				2.0 (6.0)				2.4(7.0)		3.2(8.5)	
	Abs. Pump No.2	kW(A)	0.3(1.4)				0.4(1.5)				1.2(4.0)			
	Ref. Pump	kW(A)	0.2(1.2)				0.3(1.3)				0.4(1.4)			
	Purge Pump	kW(A)	0.4 (1.3)											
	Burner Blower	kW(A)	0.37 (1.0)			0.75 (2.1)				1.5 (4.0)			2.2 (5.0)	
	Control Panel	kW(A)	0.2 (0.5)											
	Total Amp.	A	9.4			10.5			12.7			14.6	18.2	20.7
Size	Length(L)	mm	2,620			2,820			2,660	2,860	3,660		3,700	4,770
	Width(W)	mm	1,800				1,950				2,075		2,110	2,200
	Height(H)	mm	1,880				2,040				2,029		2,390	2,390
Weight	Rigging	Ton	2.8	3.0	3.3	3.7	4.0	4.2	5.1	5.6	6.4	7.6	8.1	
	Operation	Ton	3.2	3.4	3.6	4.0	4.8	5.0	6.1	6.7	7.9	8.2	9.1	
Space for Tube Replacement	mm	2,000			2,400				3,400				4,500	

- Remark**
- 1) 1usRT = 3,024 kcal/h
  - 2) Working Pressure of each water side is based on 1.0MPa [151psig]
  - 3) Natural Gas LHV(Lower Heating Value) : 9,500kcal/Nm<sup>3</sup>
  - 4) Fouling factor 0.0001m<sup>2</sup>·h·°C/kcal for Absorber and Condenser, 0.0001m<sup>2</sup>·h·°C/kcal for Evaporator.
  - 5) Catalogue specifications are subject to change without prior notice.

Model		Unit	WDAE 032	WDAE 036	WDAE 040	WDAE 045	WDAE 050	WDAE 056	WDAE 063	WDAE 070	WDAE 080	WDAE 090	WDAE 100	
Cooling capacity	usRT		320	360	400	450	500	560	630	700	800	900	1000	
	kW		1,125	1,266	1,406	1,582	1,758	1,969	2,215	2,461	2,813	3,165	3,516	
Heating Capacity	Mcal/h		849	955	1,061	1,193	1,326	1,485	1,671	1,856	2,121	2,386	2,651	
	kW		987	1,110	1,234	1,387	1,542	1,727	1,943	2,158	2,466	2,774	3,082	
Chilled & Hot Water	Temp. (inlet/outlet)	°C	12 / 7 (Heating 55.6 / 60 °C)											
	Flow rate	ton/h	193.5	217.7	241.9	272.2	302.4	338.7	381.0	423.4	483.8	544.3	604.8	
	P. Drop	mAq	5.2	5.7	5.9	5.1	5.3	4.2	5.7	7.6	5.5	7.4	9.7	
	Connection	mm	150			200			250					
Cooling Water	Temp. (inlet/outlet)	°C	32 / 37											
	Flow rate	m <sup>3</sup> /h	320	360	400	450	500	560	630	700	800	900	1000	
	P. Drop	mAq	8.8	8.9	8.8	8.6	8.7	6.4	8.8	11.7	9.1	12.3	16.2	
	Connection	mm	200			250			300			350		
Fuel	Gas	Cooling	Nm <sup>3</sup> /h	77.5	87.2	96.9	109.0	121.2	135.7	152.7	169.6	232.6	261.7	290.8
		Heating	Nm <sup>3</sup> /h	97.0	109.1	121.2	136.2	151.4	169.6	190.8	211.9	232.1	261.1	290.1
	Connection	mm	50 (4,000mmAq)											
Fuel	Oil	Cooling	kg/h	105.2	118.3	131.5	147.9	164.3	184.1	207.1	230.1	263.0	295.8	328.7
		Heating	kg/h	124.9	140.5	156.1	175.7	195.2	218.6	245.9	273.3	262.3	295.1	327.9
	Connection	mm	20						25					
Electric	Power Source		3φ 400V 50Hz											
	Abs. Pump No.1	kW(A)	3.2(8.5)	3.4(9.5)			5.5(14.3)			6.6(17)				
	Abs. Pump No.2	kW(A)	1.2 (4.0)	1.5 (4.8)			2.0 (6.0)			2.2(6.5)				
	Ref. Pump	kW(A)	0.4(1.4)						1.5(4.0)					
	Purge Pump	kW(A)	0.4 (1.3)											
	Burner Blower	kW(A)	2.2 (5.0)		3.0 (6.5)			5.5 (13.0)			7.5 (15.8)			
	Control Panel	kW(A)	0.2 (0.5)											
	Total Amp.	A	20.7	22.5	24.0			36.5			45.1			
Size	Length(L)	mm	4,770	4,880		4,970		5,100	5,600	6,110	5,750	6,250	6,800	
	Width(W)	mm	2,200	2,370		2,640		3,250		3,330	3,400			
	Height(H)	mm	2,454	2,600		2,800		3,400			3,600			
Weight	Rigging	Ton	8.7	10.8	11.0	13.2	13.4	18.1	19.6	21.0	27.9	30.2	32.6	
	Operation	Ton	9.8	12.3	12.7	15.2	15.5	20.7	22.3	24.0	31.8	34.3	37.0	
Space for Tube Replacement	mm	4,500						5,200	5,700	5,200	5,700	6,200		

# SPECIFICATION [WDA-H Series]

## Direct Fired Absorption Chiller & Heater

### COP 1.51(LHV) High-efficiency model

MODEL		Units	WDAH 004	WDAH 005	WDAH 006	WDAH 007	WDAH 008	WDAH 010	WDAH 012	WDAH 015	WDAH 018	WDAH 021	WDAH 024			
Cooling capacity	usRT		40	50	60	70	80	100	120	150	180	210	240			
	kW		141	176	211	246	281	352	422	527	633	738	844			
Heating Capacity	Mcal/h		106	133	159	186	212	265	318	398	477	557	636			
	kW		123	155	185	216	247	308	370	463	555	648	740			
Chilled & Hot Water	Temp. (inlet/outlet)	°C	12 / 7Heating 55.6 / 60)													
	Flow rate	m <sup>3</sup> /h	24.2	30.2	36.3	42.3	48.4	60.5	72.6	90.7	108.9	127.0	145.2			
	P.Drop	mAq	4.8	5.5	4.1	4.3	4.0	4.3	5.4	5.8	5.7	5.8	4.0			
	Connection	mm	80				100				125		150			
Cooling Water	Temp. (inlet/outlet)	°C	32 / 37													
	Flow rate	m <sup>3</sup> /h	40	50	60	70	80	100	120	150	180	210	240			
	P.Drop	mAq	5.4	6.0	5.9	6.0	4.3	4.8	6.4	7.3	7.3	7.8	6.6			
	Connection	mm	100				125				150		200			
Fuel	Gas	Cooling	Nm <sup>3</sup> /h	8.9	11.2	13.4	15.7	17.9	22.4	26.8	33.6	40.3	47.0	53.7		
		Heating	Nm <sup>3</sup> /h	11.6	14.5	17.4	20.4	23.3	29.1	34.9	43.6	52.3	61.1	69.8		
	Connection	mm	40 (4,000mmAq)													
Electric	Power Source	—	3 φ 400V 50Hz													
	Abs. Pump No.1	kW (A)	1.2 (4.0)				2.0 (6.0)				2.4 (7.5)		3.0 (11.0)			
	Abs. Pump No.2	kW(A)	0.3 (1.6)				0.4 (1.6)				1.2 (4.5)					
	Ref.Pump	kW (A)	0.2 (1.1)				0.3 (1.5)				0.4 (1.5)					
	Purge Pump	kW (A)	0.4 (1.4)													
	Burner Blower	kW (A)	0.37 (1.0)			0.72 (2.1)				1.5 (4.0)			2.2 (5.0)			
	Control Panel	kW (A)	0.2 (0.5)													
Total Amp.	kW (A)	2.67 (9.6)			3.055 (10.7)			4.05 (13.1)			4.8 (15.0)	6.1 (19.4)		7.4 (23.9)		
Size	Length(L)	mm	2,630			2,700			2,800		3,660		3,700		4,770	
	Width(W)	mm	1,840			1,840			1,970			2,075		2,100		2,200
	Height(H)	mm	1,978				2,150				2,500			2,510		
Weight	Rigging	Ton	2.8	3.0	3.3	3.7	4.0	4.2	5.1	5.6	6.4	7.6	8.1			
	Operation	Ton	3.2	3.4	3.6	4.0	4.8	5.0	6.1	6.7	7.9	8.2	9.1			
Space for Tube Replacement	mm	2,000			2,400				3,400				4,500			

**Remark** 1) 1usRT = 3,024 kcal/h

2) Working Pressure of each water side is based on 1.0MPa [151psig]

3) Natural Gas LHV(Lower Heating Value) : 9,500kcal/Nm<sup>3</sup>, Diesel Oil LHV(Lower Heating Value) : 9,200kcal/kg

4) Fouling factor 0.0001m<sup>2</sup>·h·°C/kcal for Absorber and Condenser, 0.0001m<sup>2</sup>·h·°C/kcal for Evaporator.

5) Catalogue specifications are subject to change without prior notice.

MODEL		Units	WDAH 028	WDAH 032	WDAH 036	WDAH 040	WDAH 045	WDAH 050	WDAH 056	WDAH 063	WDAH 070	WDAH 080	WDAH 090		
Cooling capacity		usRT	280	320	360	400	450	500	560	630	700	800	900		
		kW	984	1,125	1,266	1,406	1,582	1,758	1,969	2,215	2,461	2,813	3,165		
Heating Capacity		Mcal/h	742	849	955	1,061	1,193	1,326	1,485	1,671	1,856	2,121	2,386		
		kW	863	987	1,110	1,234	1,387	1,542	1,727	1,943	2,158	2,466	2,774		
Chilled & Hot Water	Temp. (inlet/outlet)	°C	12 / 7(Heating 55.6 / 60°C)												
	Flow rate	m <sup>3</sup> /h	169.3	193.5	217.7	241.9	272.2	302.4	338.7	381.0	483.8	544.3	604.8		
	P.Drop	mAq	4.1	4.6	4.9	3.8	4.2	3.4	4.6	6.3	4.3	6.0	8.1		
	Connection	mm	150				200				250				
Cooling Water	Temp. (inlet/outlet)	°C	32 / 37												
	Flow rate	m <sup>3</sup> /h	280	320	360	400	450	500	560	630	700	800	900		
	P.Drop	mAq	6.9	7.3	7.3	6.8	7.0	5.2	7.2	9.7	7.2	10.0	13.4		
	Connection	mm	200				250			300			350		
Fuel	Gas	Cooling	Nm <sup>3</sup> /h	62.6	71.6	80.5	89.5	100.7	111.8	125.3	140.9	156.6	178.9	201.3	
		Heating	Nm <sup>3</sup> /h	81.4	93.0	104.7	116.3	130.8	145.4	162.8	183.2	232.6	261.7	290.8	
	Connection	mm	40 (4,000mmAq)						50 (4,000mmAq)						
Electric	Power Source		3 φ 400V 50Hz												
	Abs. Pump No.1		kW (A)	3.0 (11.0)	3.4 (10.2)				5.5 (14.5)			6.6 (16.2)			
	Abs. Pump No.2		kW (A)	1.2(4.5)	1.5 (5.0)				2.0 (6.0)			2.2 (7.0)			
	Ref.Pump		kW (A)	0.4 (1.5)						1.5 (4.0)					
	Purge Pump		kW (A)	0.4 (1.4)											
	Burner Blower		kW (A)	2.2 (5.0)		3.0 (6.5)			5.5 (13.0)			7.5 (15.8)			
	Control Panel		kW (A)	0.2 (0.5)											
Total Amp.		kW (A)	7.4(23.9)	8.1(23.6)	8.9(25.1)			14(36.9)			18.4(44.9)				
Size	Length(L)		mm	4,770	4,870		4,900		5,100	5,600	6,150	5,750	6,250	6,800	
	Width(W)		mm	2,200	2,300	2,430	2,650			3,150			3,400		
	Height(H)		mm	2,510	2,640		2,900		3,394			3,720			
Weight	Rigging		Ton	8.7	10.8	11.0	13.2	13.4	18.1	19.6	21.0	27.9	30.2	32.6	
	Operation		Ton	9.8	12.3	12.7	15.2	15.5	20.7	22.3	24.0	31.8	34.3	37.0	
Space for Tube Replacement		mm	4,500						5,200	5,700	5,200	5,700	6,200		

# Double Lift Hot Water Absorption Chiller

75RT ~ 1500RT 27 Models

Hot Water Temp. : 95°C->55°C ( $\Delta T 40^{\circ}\text{C}$ )



**WDLE / Stable, Convenient, Efficient and Reliable**

## Non-carbon eco-friendly chiller

- Use of regional heating hot water (Energy use efficiency 84%. The ratio of incineration heat of the combined waste heat - 74%)
- Use of natural refrigerant water instead of Freon refrigerant destroying ozone layer
- No CO<sub>2</sub> and No<sub>x</sub> which cause the global warming

## Zero explosive danger by vacuum operation

- Internal pressure vacuum
- No danger of gas explosion by use of hot water
- Safety from the danger of high-pressure damage

## The excellent partial load part-load value

- Auxiliary cycle auto stop if the cooling load is below 80%
- Energy saving by 25% per chilled ton due to the increase in the efficiency by 25%

## Low noise & Low vibration

- Noise level: Below 75 dB at 1m distance

## IPLV(Integrated Part-Load Value)

Single effect double lift type	Chilled water inlet °C	Cooling capacity	COP	Part Load rate	IPLV
	31.0	100%	0.64	0.01	
	29.8	75%	0.82	0.42	
	28.8	50%	0.85	0.45	
	28.0	25%	0.81	0.12	
Single effect type	Chilled water inlet °C	Cooling capacity	COP	Part Load rate	IPLV
	31.0	100%	0.72	0.01	
	29.9	75%	0.71	0.42	
	29.1	50%	0.68	0.45	
	28.1	25%	0.59	0.12	

- 1) Chilled water outlet temp keeps at 8°C and hot water inlet temp keeps at 95°C
- 2) Assuming that the ambient humid temp is 27°C for the chilled water inlet temp, it was designed to be lower depending on the hot water flow rate.
- 3) Part load rate is subject to the paragraph 5.3.2.2 of AR1560-2000.

## Economic air-conditioning

- Conventional Chiller:  $\Delta 15^{\circ}\text{C}$  (95°C -> 80°C)
  - Insufficient heating hot water
- Sing-effect/ Double-lift Chiller:  $\Delta 40^{\circ}\text{C}$  (95°C -> 55°C)
  - Saving 60% of the existing hot water use capacity
  - Wide range of the use


## Micro processor control with only start-up signal for automatic operation

- Precise control of start-up, stop, capacity control, abnormal stop, etc.
- Easy to handle due to the touch screen
- Control of auxiliary cycle, self-diagnostic function & other controls

## Saving maintenance cost


- Leakage per month: 3cc or below. High vacuum condition
- Auto steam extraction. Non-condensing gas storage
- Optimal condition of the operation
- Operating with only minimum purging

## Comparison of partial load COP

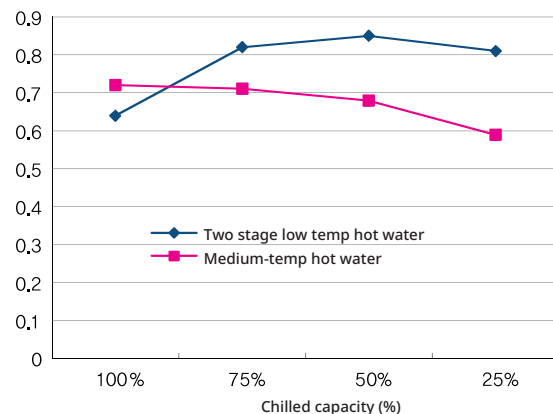

# CYCLE DIAGRAM

## Double Lift Hot Water Absorption Chiller

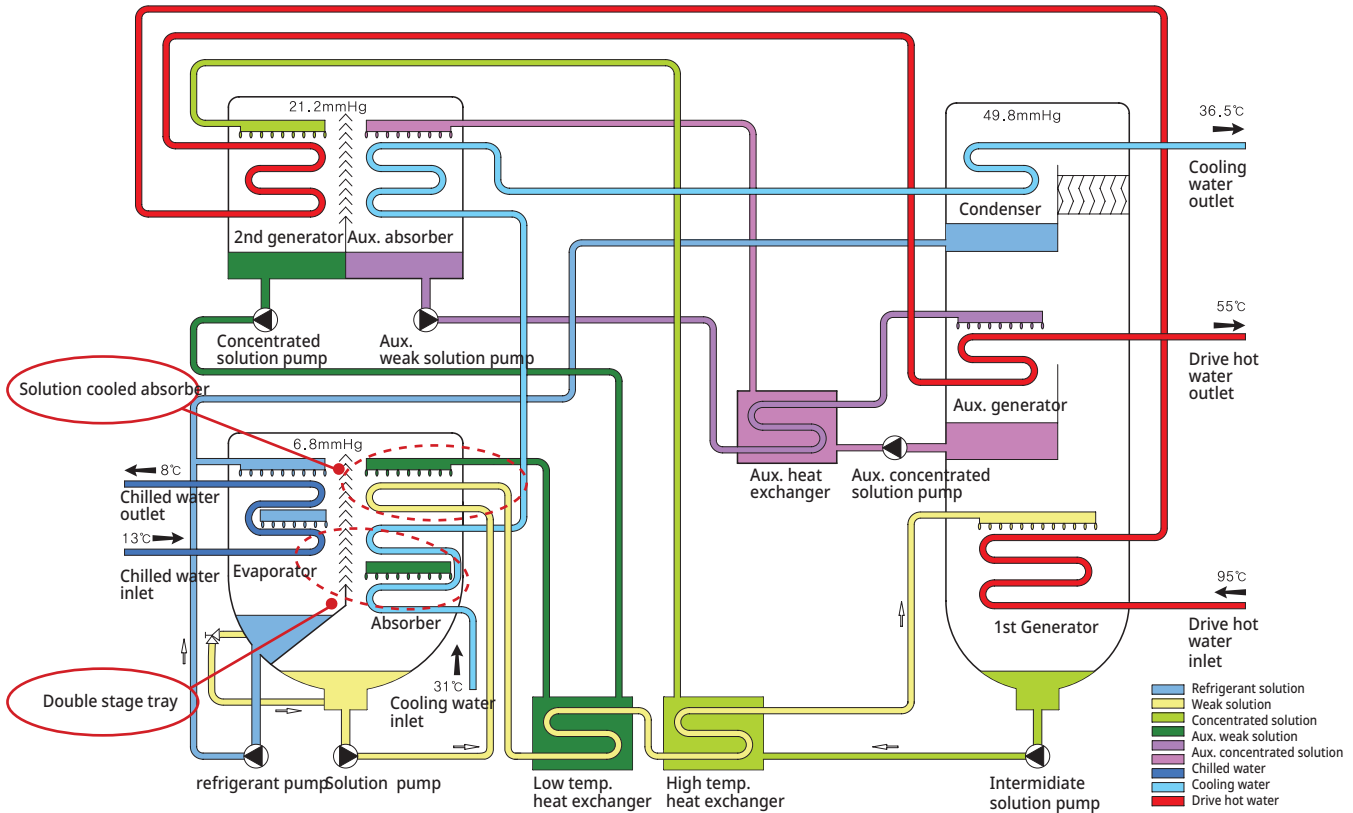


As the refrigerant is evaporated from the evaporator, the chilled water flowing inside the heating tube of the evaporator is cooled down and the refrigerant evaporated is absorbed by the concentrated absorbing liquid from the 2nd generator. The concentrated absorbing liquid will become thick absorbing liquid and the heat generated will be absorbed by the chilled water. The thick absorbing liquid which absorbed the refrigerant steam from the absorbing unit will go to the 1st generator passing through the low-temp and high-temp heat exchangers. The hot water at 95°C in the 1st generator will heat the thick absorbing liquid to generate the refrigerant steam and then it flows to the 2nd generator after passing through the high-temp heat exchanger. The medium concentrated thick absorbing liquid comes from the 2nd generator will be heated by the hot water coming from the 1st generator and it generates the refrigerant steam.

The refrigerant steam generated from the 2nd generator will be absorbed by the absorbing liquid flowing outside the heat tube and the thick absorbing liquid which absorbed the refrigerant steam from the aux absorbing unit will flow to the aux generator after passing through aux heat exchanger, so that it is heated by the hot water flowing the heat tube of the aux generator to generate the refrigerant steam. Then, the concentrated absorbing liquid is returned back to the aux absorbing unit after passing through the aux heat exchanger.


The refrigerant steam generated from the 1st generator and the aux generator will condense the refrigerant with the leakage of the chilled water inside the heat tube and then it absorbs the heat generated.

That is, the hot water flows the 1st generator → 2nd generator → aux generator while the chilled water flows absorbing unit → aux absorbing unit → condenser in order to form a chilled cycle. In addition, the low-temp hot water two stage absorbing chiller has main cycle and aux cycle and the details of the solution (liquid) flow are as below.

### Main cycle solution flow



### Aux cycle solution flow



# SPECIFICATION [WDLE Series]

## Double Lift Hot Water Absorption Chiller

Model		Unit	WDLE 75	WDLE 90	WDLE 110	WDLE 135	WDLE 155	WDLE 180	WDLE 210	WDLE 240	WDLE 270	WDLE 300	WDLE 340	WDLE 375		
Cooling capacity		usRT	75	90	110	135	155	180	210	240	270	300	340	375		
		kW	264	317	387	475	545	633	739	844	950	1055	1196	1319		
Chilled Water	Temp. (inlet/outlet)	°C	12 / 7													
	Flow rate	m <sup>3</sup> /h	45.4	54.4	66.5	81.6	93.7	108.9	127.0	145.2	163.3	181.4	205.6	226.8		
	P. Drop	mH <sub>2</sub> O	6.7	6.9	10.0	10.7	9.8	9.8	9.9	9.7	10.2	10.2	8.9	9.5		
	Connection	A	80		100			125			150		200			
Cooling Water	Temp. (inlet/outlet)	°C	32 / 37													
	Flow rate	m <sup>3</sup> /h	98.3	117.9	144.1	176.9	203.1	235.9	275.2	314.5	353.8	393.1	445.5	491.4		
	P. Drop	mH <sub>2</sub> O	6.7		10.6	10.9	11.6	12.1	11.9		11.1			11.2		
	Connection	mm	125		150			200			250					
Driving Hot Water	Temp.	°C	95 / 55													
	Flow rate	ton/h	7.8	9.3	11.4	14.0	16.1	18.6	21.7	24.9	28.0	31.1	35.2	38.8		
	P. Drop	Shell	mH <sub>2</sub> O	2.8	2.8	4.2	4.4	4.5	4.5	5.4	5.3	4.1	4.3	5.2	5.3	
		Control Valve	mH <sub>2</sub> O	1.6	2.3	2.2	2.1	2.8	2.3	2.0	2.7	2.1	2.6	2.1	2.6	
	Connection	A	65			80			100							
	Control Valve Size	A	40			50			65			80				
Electric	Power Source		3Φ 400V 50Hz													
	Abs. Pump	kW (A)	3.0 (11.9)		3.7 (13.3)		4.0 (14.1)		4.5 (15.3)		4.7 (15.3)		5.1 (17.1)			
	Ref. Pump	kW (A)	0.2 (1.2)		0.3 (1.4)				0.4 (1.4)							
	Purge Pump	kW (A)	0.4 (1.3)													
	Control Panel	kW (A)	0.2 (0.5)													
	Total Amp.	A	14.9		16.5		17.3		18.5		18.5		20.3			
Size	Length(L)	mm	2,670		3,664		3,715		4,760		4,872		4,884			
	Width(W)	mm	1,702						1,845			2,096		2,273		
	Height(H)	mm	2,556				2,710				2,788		3,118			
Weight	Rigging	ton	4.5	4.7	5.8	6.1	7.3	7.7	9.0	9.4	11.5	12.0	13.8	14.3		
	Operation	ton	5.2	5.4	6.7	7.1	8.6	9.1	10.6	11.1	13.7	14.4	16.5	17.2		
Space for Tube Replacement	mm	2,400			3,400				4,600							




Model		Unit	WDLE 420	WDLE 470	WDLE 525	WDLE 600	WDLE 675	WDLE 750	WDLE 825	WDLE 900	WDLE 975	WDLE 1050	WDLE 1125	WDLE 1300	
Cooling capacity		usRT	420	470	525	600	675	750	825	900	975	1050	1125	1300	
		kW	1477	1653	1846	2110	2374	2638	2901	3165	3429	3693	3957	4572	
Chilled Water	Temp. (inlet/outlet)	°C	12 / 7												
	Flow rate	m <sup>3</sup> /h	254.0	284.3	317.5	362.9	408.2	453.6	499.0	544.3	589.7	635.0	680.4	786.2	
	P. Drop	mH <sub>2</sub> O	8.6	3.9	5.2	9.9	4.4	5.9	4.2	5.4	6.8	5.2	6.4	5.9	
	Connection	A	200			250			300						
Cooling Water	Temp. (inlet/outlet)	°C	32 / 37												
	Flow rate	m <sup>3</sup> /h	550.3	615.9	687.9	786.2	884.5	982.7	1081.0	1179.3	1277.6	1375.8	1474.1	1703.4	
	P. Drop	mH <sub>2</sub> O	8.0	10.9	12.6	10.7	12.4	14.4	11.6	7.9	9.9	6.6	8.1	11.9	
	Connection	mm	300			350			400			450			
Driving Hot Water	Temp.	°C	95 / 55												
	Flow rate	ton/h	43.5	48.7	54.4	62.1	69.9	77.7	85.4	93.2	101.0	108.7	116.5	134.6	
	P. Drop	Shell	mH <sub>2</sub> O	3.7	3.8	2.9	4.3	5.8	3.1	2.8	3.5	4.3	3.7	4.3	5.5
		Control Valve	mH <sub>2</sub> O	2.0	2.6	1.4	1.9	2.3	2.9	1.6	1.9	2.3	2.6	3.0	2.2
	Connection	A	100			125			150						
	Control Valve Size	A	80		100			125			150				
Electric	Power Source		3Φ 400V 50Hz												
	Abs. Pump	kW (A)	5.8 (18.8)			7.8 (22.5)	10(30.9)		10.6 (34.8)			14.8 (49.3)			
	Ref. Pump	kW (A)	0.4 (1.4)				1.5 (4.0)								
	Purge Pump	kW (A)	0.4 (1.3)												
	Control Panel	kW (A)	0.2 (0.5)												
	Total Amp.	A	22			25.7	36.7		40.6			55.1			
Size	Length(L)	mm	4,994	5,536	6,034	5,650	6,180	6,705	6,505	7,005	7,505	7,050	7,700	8,700	
	Width(W)	mm	2,446			2,770			3,565			3,980			
	Height(H)	mm	3,468			3,740			4,194			4,380			
Weight	Rigging	ton	19.4	21.1	22.6	27.2	29.3	31.3	37.1	39.2	41.6	45.2	48.4	56.0	
	Operation	ton	23.5	25.5	27.4	32.2	34.7	37.0	44.0	46.4	49.3	53.7	57.5	66.5	
Space for Tube Replacement	mm	4,600	5,200	5,700	5,200	5,700	6,200	5,700	6,200	6,700	6,300	6,800	7,800		

# Double Stage Hot Water Absorption Chiller

30RT ~ 300RT 13 Models

Hot Water Temp. : 95°C->75°C ( $\Delta T 20^{\circ}\text{C}$ )

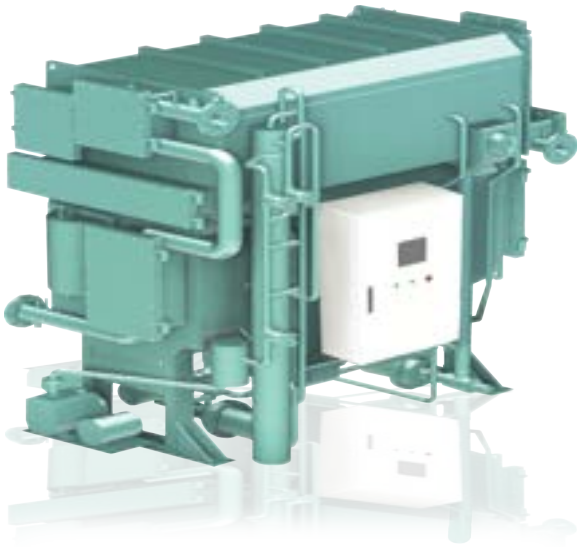


Hot Water temp. 95°C → 75°C


## Economic Air-Condition

Chiller Type	Hot Water Temp.		Temp. Gap
	Inlet	→ Outlet	
Conventional (General Chiller)	95°C	→ 80°C	$\Delta 15^{\circ}\text{C}$
WORLD EnC (New Developed Chiller)	95°C	→ 75°C	$\Delta 20^{\circ}\text{C}$

## IPLV Graph

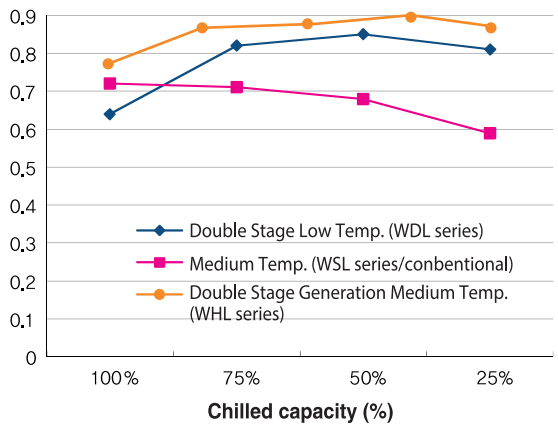

## Cycle Diagram

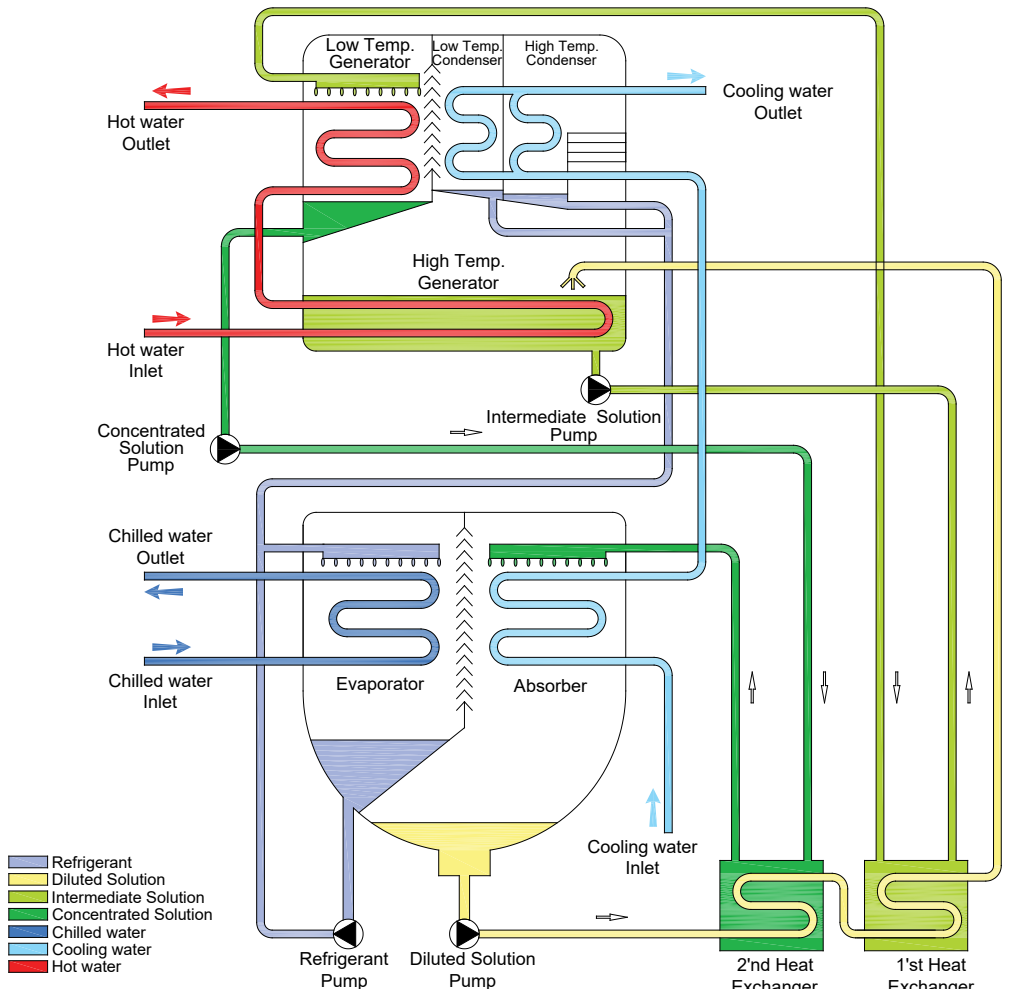

## Patent



# SPECIFICATION [WHL Series]

## Double Stage Hot Water Absorption Chiller

MODEL		UNIT	WHL 30	WHL 40	WHL 50	WHL 75	WHL 90	WHL 110	WHL 135	WHL 155	WHL 180	WHL 210	WHL 240	WHL 270	WHL 300		
Cooling Capacity		kW	105	141	176	264	316	387	474	545	633	738	844	949	1,054		
		usRT	30	40	50	75	90	110	135	155	180	210	240	270	300		
Chilled Water	Temp. (inlet/outlet)	°C	12 / 7														
	Flow Rate	m³/h	18.1	24.2	30.2	45.4	54.4	66.5	81.6	93.7	109.0	127.0	145.0	163.0	181.4		
	Pressure Drop	mH <sub>2</sub> O	7.3	8.3	7.0	6.4	6.8	9.6	10.5	9.5	9.6	9.7	9.5	10.2	10.5		
	Connection Size	mm	65			80			100			125			150		
Cooling Water	Temp. (inlet/outlet)	°C	32 / 37														
	Flow Rate	m³/h	37.1	49.5	61.9	92.8	111.3	136.1	167.0	240.2	222.7	259.8	296.9	334.0	371.1		
	Pressure Drop	mH <sub>2</sub> O	8.9	9.8	12.0	8.4	8.8	8.0	8.7	12.0	8.5	7.5	7.6	7.5	7.3		
	Connection Size	mm	80			100			125			150			200		
Hot Water	Temp.	°C	95 / 75														
	Flow Rate	ton/h	4.5	6.0	7.6	11.3	13.6	16.6	20.4	23.4	27.2	31.8	36.3	40.8	45.4		
	Pressure Drop	Shell	mH <sub>2</sub> O	1.6	2.0	3.4	3.1	3.2	4.3	4.8	4.3	4.3	5.1	4.9	4.9	4.7	
		Control Valve	mH <sub>2</sub> O	2.2	1.5	1.0	2.2	2.1	3.1	1.9	2.5	3.3	1.8	2.3	3.0	1.4	
	Connection Size	mm	65						80						100		
	Control Valve Size	mm	25	40			50			65			80			100	
Electric	Power Source	-	3Φ 400V 50Hz														
	Abs. Pump	kW (A)	1.6 (6.6)			1.8 (7.2)			2.1 (8.2)			2.8 (9.2)			3.2 (10.2)		
	Ref. Pump	kW (A)	0.2 (1.1)						0.3 (1.5)						0.4 (1.5)		
	Purge Pump	kW (A)	0.4 (1.4)														
	Control Panel	kW (A)	0.2 (0.5)														
	Total Ampere	kW (A)	2.4 (9.6)			2.6 (10.2)			3 (11.6)			3.7 (12.6)			4.2 (13.6)		
Size	Length[L]	mm	2,052		2,552	2,605		3,680		3,710		4,740		4,780			
	Width[W]	mm	1,351				1,370				1,520				1,810		
	Height [H]	mm	2,133				2,370				2,430				2,670		
Weight	Rigging	ton	2.2	2.3	2.8	4.0	4.2	5.1	5.3	6.1	6.4	7.5	7.8	9.7	10.1		
	Operating	ton	2.6	2.7	3.3	4.7	4.9	5.7	5.9	6.8	7.1	8.3	8.7	10.8	11.2		

- Remark**
- 1) 1usRT = 3,024 kcal/h
  - 2) Available max. working pressure of chilled water /cooling water/hot water : 1.0MPa
  - 3) Fouling factor 0.0001 m<sup>2</sup>h<sup>2</sup>C/kcal for Absorber and Condenser, 0.0001<sup>2</sup>m<sup>2</sup>h<sup>2</sup>C/kcal for Evaporator and Generator.
  - 4) Catalogue specifications are subject to change without prior notice.


# Hot Water Absorption Chiller

75RT ~ 1125RT 27 Models



WSL / Hot Water Absorption

## Hot water Absorption chiller operation flow chart

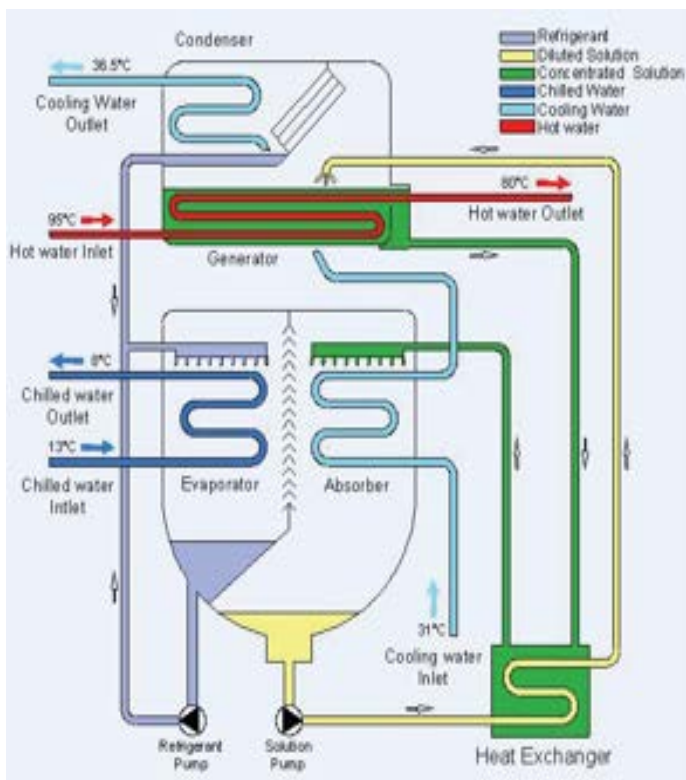

### 1. Compact and Energy saving Design

With using high efficiency heat tube, smaller and lighter design to conventional things. Installation space also gets decreased.

### 2. Easy operation and convenience

Full automatic system with up-to-date control technology such as operation, setting, monitoring, and control flow chart.

### 3. Safe and efficient chiller

Being operated in vacuum condition, it keeps internal pressure in vacuum status even in stop mode. With 2 pumps for solution and refrigerant, it is totally quiet. No noise and No vibration.

### 4. Maintenance cost reduction and only one purging during a season

Optimized operation condition and trouble-free system under strict manufacturing standard:  $1 \times 10^{-6}$  atm.cc/sec leakage for a month.

### 5. High performance Automatic Purge system

An automatic purge unit to collect into a purge tank remaining Non-condensable gases in system and purge tank for storing Non-condensable gases make long time operation without manual purging.

# SPECIFICATION [WSL Series]

## Hot Water Absorption Chiller

### Hot water inlet temp. 95°C

Model	Unit	WSL75	WSL90	WSL110	WSL135	WSL155	WSL180	WSL210	WSL240	WSL270	WSL300	
Chilled water temp. at in-outlet	°C	12 / 7										
Cooling capacity	usRT	70	85	103	122	141	169	198	226	254	282	
Chilled water	Flow rate	m <sup>3</sup> /h	42,3	51,4	62,3	73,8	85,3	102,2	119,8	136,7	153,6	170,6
	Pressure drop	mAq	7,8	8,5	7,5	7,4	7,0	7,9	7,5	7,9	7,8	8,0
	Pipe size	mm	80		100		125			150		
Cooling water	Flow rate	m <sup>3</sup> /h	92,5	112,3	136,1	161,1	186,2	223,2	261,5	298,5	335,5	372,5
	Pressure drop	mAq	10,1	9,8	4,7	4,2	4,6	4,8	9,7	9,5	9,3	9,0
	Pipe size	mm	125		150			200				
Hot water	Flow rate	m <sup>3</sup> /h	19,6	23,8	28,8	34,2	39,5	47,3	55,4	63,3	71,1	79,0
	Pressure drop	mmAq	0,9	0,9	0,4	0,5	0,5	0,5	1,1	1,1	1,0	1,0
	Pipe size	mm	65		80			100				
	Valve size	mm	50	65		80			100			
Electricity	Power	-	3φ 400V 50Hz									
	Solution Pump	kW(A)	1,5(4,7A)			2,0(6,1A)			2,4(7,3A)			
	Refrigerant Pump	kW(A)	0,3(1,7A)						0,4(1,7A)			
	Purge Pump	-	0,4(1,5A)									
	Total Ampere	kW(A)	2,2 (7,9)			2,7 (9,3)			3,2 (10,5)			
Dimension	Length	mm	2,640		3,680		3,686		4,744		4,776	
	Width	mm	1,244		1,244		1,369		1,365		1,495	
	Height	mm	2,255		2,255		2,389		2,389		2,575	
Weigh	Equipment weight	Ton	3,6	3,7	4,6	4,8	5,8	6,0	7,0	7,3	9,0	9,4
	Operation weight	Ton	4,1	4,3	5,3	5,6	6,7	7,1	8,2	8,7	10,6	11,1
	Conveyance	-	One body									

- Remark**
- Standard pressure:  
Cooling and Chilled water: 0.8Mpagf(8kgf/cm<sup>2</sup>G),  
Hot water standard pressure: 1.6Mpa(16kgf/cm<sup>2</sup>G)
  - Chilled water standard TEMP: Inlet: 12°C, Outlet :7°C  
Cooling water standard TEMP: Inlet: 32°C, Outlet :37°C
  - Hot water standard TEMP: Inlet: 95°C, Outlet :80°C.
  - Power standard : 400V, 3Phase,50Hz,(220,440,460V also available)
  - The specification could be changed without any notice.

# SPECIFICATION [WSL Series]

## Hot Water Absorption Chiller

### Hot water inlet temp. 95°C

Model	Unit	WSL340	WSL375	WSL420	WSL470	WSL525	WSL600	WSL675	WSL750	WSL825	
Chilled water temp. at in-outlet	°C	12-7									
Cooling capacity	usRT	320	360	399	446	494	569	641	712	783	
Chilled water	Flow rate	m³/h	193,5	217,7	241,3	269,7	298,8	344,4	387,4	430,5	473,5
	Pressure drop	mAq	7.1	7.6	6.0	8.1	3.5	2.5	3.5	4.6	3.5
	Pipe size	mm	200				250				300
Cooling water	Flow rate	m³/h	422,7	475,5	527,0	589,1	652,5	752,1	846,1	940,2	1034,2
	Pressure drop	mAq	9,4	9,8	6,8	9,2	12,1	8,9	12,0	15,9	16,2
	Pipe size	mm	250		300			350			400
Hot water	Flow rate	m³/h	89,6	100,8	111,7	124,98	138,3	159,4	179,4	199,3	219,2
	Pressure drop	mAq	1,0	1,0	1,0	1,4	1,9	1,2	1,5	2,1	2,3
	Pipe size	mm	125				150				200
	Valve size	mm	125				150				200
Electricity	Power	-	3φ 400V 50Hz								
	Solution Pump	kW(A)	2,4(7,3A)		3,0(10A)					4,5(16,2A)	
	Refrigerant Pump	kW(A)	0,4(1,7A)								1,5(4,0A)
	Purge Pump	-	0,4(1,5A)								
	Total Ampere	kW(A)	3,2 (10,5)		3,8 (13,2)					5,3 (21,7)	
Dimension	Length	mm	4,780		4,870	5,410	5,910	5,618	6,116	6,641	7,141
	Width	mm	1,595		1,955			2,200			
	Height	mm	2,850		3,150			3,840			
Weigh	Equipment weight	Ton	10,7	11,7	14,9	16,2	17,4	20,8	22,5	24,0	28,3
	Operation weight	Ton	12,7	13,2	18,0	19,6	21,0	25,0	27,0	28,8	34,0
	Conveyance	-	One Body								

**Option** In different heat source and operation, the conditions can be selected as an option.

- 1) When the water pressure different from the standard.
- 2) When heat tube material is not copper nor with different tickness.
- 3) When Hot/cooling/chilled water temp. are different from standard.

# Steam Fired Absorption Chiller

100RT ~ 1500RT 23 Models



WSA / Double Effect Steam Fired Absorption Chiller

## Eco friendly and energy-saving design

WSA uses steam as the energy resource, LiBr as absorbent and water as refrigerant. With use of eco friendly materials, WSA does not raise the carbon dioxide which causes the global warming. The cost for electricity and operation can be saved in the area where steam is enough to use.

## Reliable and efficient operation


WSA is designed to enhance the reliability and durability. Inverter control of absorbent depending on cooling load makes efficient operation.

## Intelligent operation system

Micro process control realizes precise control and efficient operation of the unit. And the user can operate the unit easily on the touch screen.

**Steam Consumption:** 3.5kg/h·RT ~ 4.4kg/h·RT

## Cycle Diagram

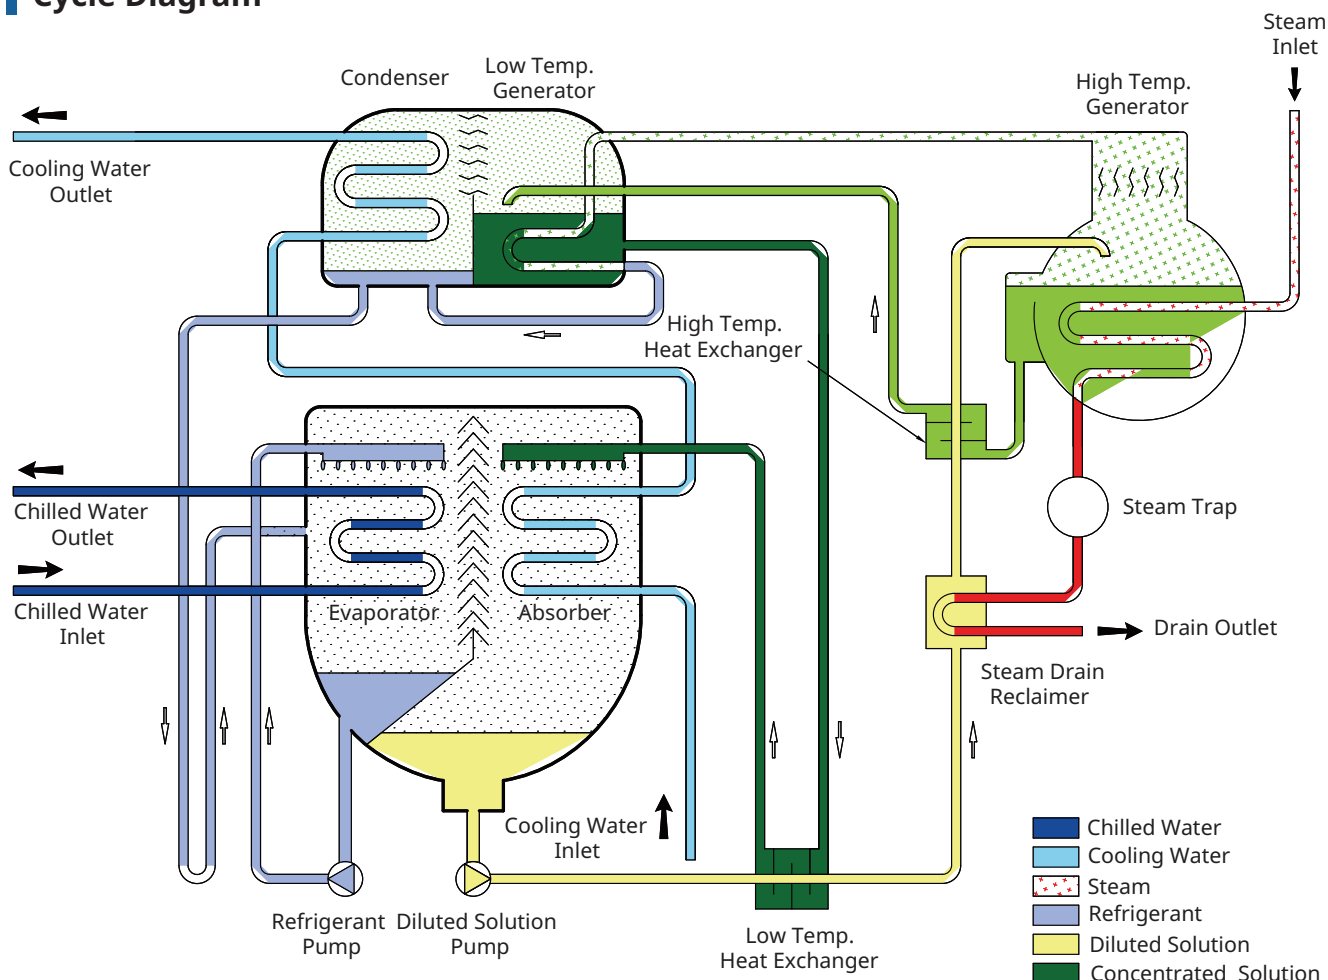

# SPECIFICATION [WSA Series]

## Steam Fired Absorption Chiller

Model		Unit	WSA 010	WSA 012	WSA 015	WSA 018	WSA 021	WSA 024	WSA 028	WSA 032	WSA 036	WSA 040	WSA 045		
Cooling capacity		usRT	100	120	150	180	210	240	280	320	360	400	450		
		kW	352	422	528	633	739	844	985	1,125	1,266	1,407	1,583		
Chilled Water	Temp. (inlet/outlet)	°C	12/7												
	Flow rate	ton/h	60,5	72,6	90,7	108,9	127,0	145,2	169,3	193,5	217,7	241,9	272,2		
	P. Drop	mAq	6,5	6,4	8,0	8,3	7,5	7,9	5,1	5,5	5,8	6,1	5,2		
	Connection	mm	100				125			150					
Cooling Water	Temp. (inlet/outlet)	°C	32/37												
	Flow rate	m <sup>3</sup> /h	100	120	150	180	210	240	280	320	360	400	450		
	P. Drop	mAq	3,9	4,4	6,5	7,7	5,6	6,2	10,9	12,1	8,7	9,4	10,3		
	Connection	mm	125				150			200					
Steam	Flow rate	kg/h	440	530	660	790	920	1060	1230	1410	1580	1760	1980		
	Steam Inlet onnect.	A	50				65				80				
	Drain Outlet onnect.	A	25								40				
	Control Valve Size	A	25	40				50							
Electric	Power Source		3φ 400V 50Hz												
	Abs. Pump #1	kW(A)	2,0 (6,0)				2,4 (7,5)			3,0 (11,0)		3,4 (10,2)		3,4	
	Abs. Pump #2	kW(A)	0,4 (1,6)				1,2 (4,5)				1,5 (5,0)		1,5		
	Ref. Pump	kW(A)	0,3 (1,5)				0,4 (1,5)								
	Purge Pump	kW(A)	0,4 (1,4)												
	Control Panel	kW(A)	0,2 (0,5)												
	Total Ampere	kW(A)	3,3 (11,0)				4,6 (15,4)			5,2 (18,9)		5,9 (18,6)			
Size	Length (L)	mm	2,632	2,832	3,644		3,670		4,720		4,860		4,910		
	Width (W)	mm	1,775				1,880				2,110		2,250		
	Height (H)	mm	2,030				2,300				2,550		2,780		
Widght	Rigging	Ton	3,9	4,1	5,1	5,2	6,2	6,4	7,7	8,0	9,8	10,1	11,8		
	Operation	Ton	4,3	4,5	5,6	5,8	6,9	7,2	8,6	9,0	11,0	11,4	13,5		
Space for Tube Replacement		mm	2,400			3,400				4,500					


- Remark**
- 1) 1usRT = 3,024 kcal/h
  - 2) Standard Steam Pressure is 0.8M
  - 3) Working Pressure of chilled water and cooling water side is based on 1.0MPaPa
  - 4) Fouling factor 0.0001m<sup>2</sup>·h·°C/kcal for Absorber and Condenser, 0.0001m<sup>2</sup>·h·°C/kcal for Evaporator.
  - 5) Catalogue specifications are subject to change without prior notice.



Model		Unit	WSA 050	WSA 056	WSA 063	WSA 070	WSA 080	WSA 090	WSA 100	WSA 110	WSA 120	WSA 130	WSA 140	WSA 150	
Cooling capacity		usRT	500	560	630	700	800	900	1000	1100	1200	1300	1400	1500	
		kW	1,758	1,969	2,216	2,462	2,814	3,165	3,517	3,869	4,220	4,572	4,924	5,275	
Chilled Water	Temp. (inlet/outlet)	°C	12/7												
	Flow rate	ton/h	302,4	338,7	381,0	423,4	483,8	544,3	604,8	665,3	725,8	786,2	846,7	907,2	
	P. Drop	mAq	5,5	4,6	6,2	8,1	4,7	6,4	8,4	6,2	7,9	9,8	8,0	9,8	
	Connection	mm	200				250			300			350		
Cooling Water	Temp. (inlet/outlet)	°C	32/37												
	Flow rate	m³/h	500	560	630	700	800	900	1000	1100	1200	1300	1400	1500	
	P. Drop	mAq	11,2	7,1	9,4	12,1	8,4	11,1	14,3	8,8	10,9	13,4	12,3	14,6	
	Connection	mm	250	300			350			400					
Steam	Flow rate	kg/h	2200	2460	2770	3080	3520	3960	4400	4840	5280	5720	6160	6600	
	Steam Inlet onnect.	A	80	100			125			150					
	Drain Outlet onnect.	A	40	50			65			80					
	Control Valve Size	A	65			80			100						
Electric	Power Source		3 Ø 400V 50Hz												
	Abs. Pump #1	kW(A)	3,4(10,2)	5,5 (20,0)			6,6 (16,2)			7,5 (25,0)					
	Abs. Pump #2	kW(A)	1,5 (5,0)	2,0 (6,0)			2,2 (7,0)			4,5 (16,0)					
	Ref. Pump	kW(A)	0,4 (1,5)				1,5 (4,0)								
	Purge Pump	kW(A)	0 4 (1,4)												
	Control Panel	kW(A)	0,2 (0,5)												
Size	Total Ampere	kW(A)	5,9 (18,6)	8,5 (29,4)			10,9 (29,1)			14,1 (46,9)					
	Length (L)	mm	4,910	5,040	5,580	6,080	5,720	6,220	6,740	6,150	6,670	7,170	6,830	7,330	
	Width (W)	mm	2,250	2,480			2,825			3,000			3,250		
	Height (H)	mm	2,780	3,255			3,400			3,600			3,650		
Widght	Rigging	Ton	12,1	16,6	18,1	19,4	24,6	26,3	28,3	31,8	33,9	35,8	39,6	41,8	
	Operation	Ton	13,9	19,2	20,8	22,3	28,7	30,7	32,8	36,4	38,8	40,9	45,3	47,7	
Space for Tube Replacement		mm	4,500		5,200	5,700	5,200	5,700	6,200	5,700	6,200	6,700	6,200	6,700	

# Exhaust Gas Absorption Chiller & Heater

100RT ~ 1500RT 23 Models

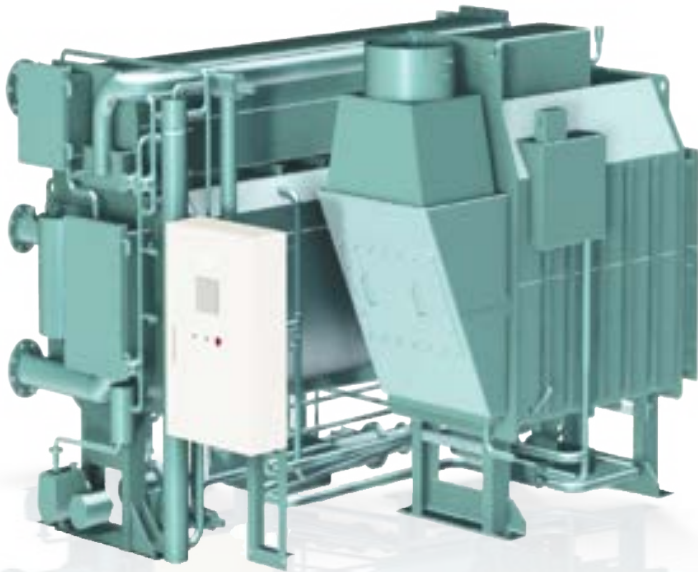


1. Waste exhaust gas can be used for drive heat source.
2. Convertible use of cooling and heating
3. Energy saving product
4. Increase in the efficiency of total energy
5. No power overload in summer season
6. Environment-friendly to use water as refrigerant

WEG / Chilled water 12 → 7°C

## Development of diverter valve

- Working at high temp 500°C. Endurability
- Maximum flow for exhaust gas: 90kg/min

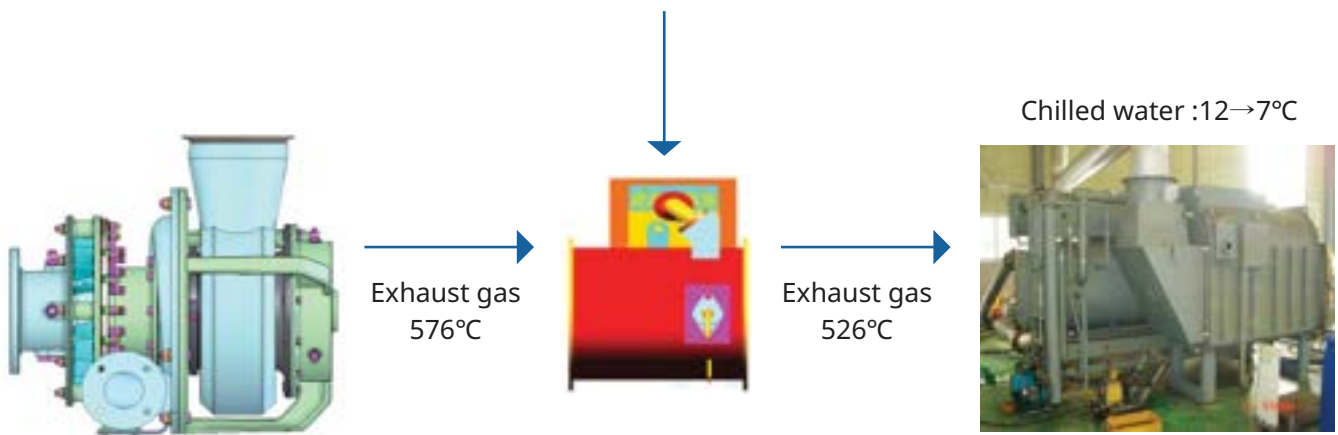


## High temp. generator

- Vertical water tube - Fin tube, 1 Pass
- UA
- Loss of pressure calculation
- Endurable from high temp corrosion


# CYCLE DIAGRAM

## Exhaust Gas Absorption Chiller & Heater


### Cooling Cycle Diagram

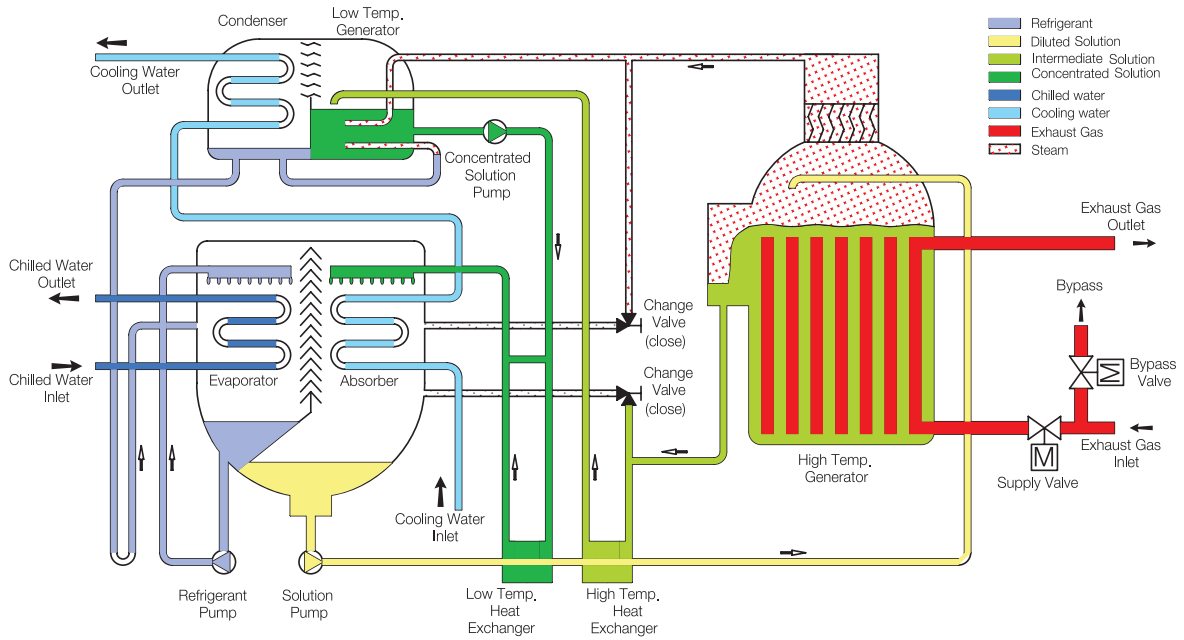

### Cooling Cycle



### Heating Cycle Diagram

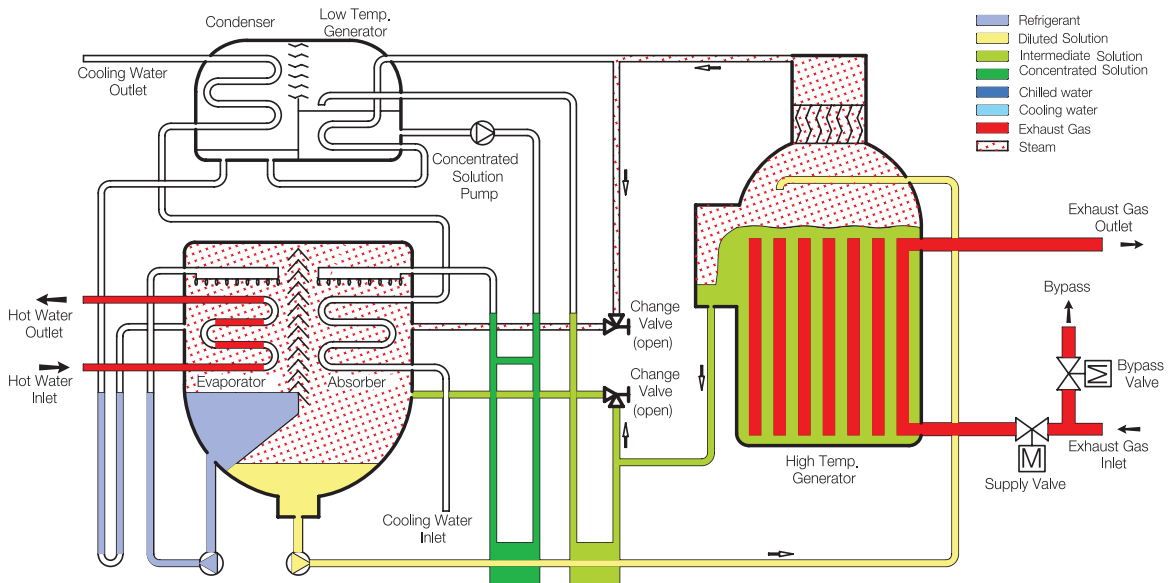

### Heating Cycle



# SPECIFICATION [WEG Series]

## Exhaust Gas Absorption Chiller & Heater


Model		Unit	WEG 010	WEG 012	WEG 015	WEG 018	WEG 021	WEG 024	WEG 028	WEG 032	WEG 036	WEG 040	WEG 045	
Cooling capacity	usRT		100	120	150	180	210	240	280	320	360	400	450	
	kW		351	422	527	633	738	844	984	1,125	1,265	1,406	1,582	
Heating capacity	Mcal/h		283	340	425	510	595	680	793	906	1019	1133	1274	
	kW		329	395	494	592	691	790	922	1053	1185	1317	1481	
Chilled Water	Temp. (inlet/outlet)	°C	12 / 7											
	Flow rate	m <sup>3</sup> /h	60,5	72,6	90,7	109	127	145	169	194	218	242	272	
	P. Drop	mAq	4,8	5,1	6,6	7,0	6,4	6,3	4,6	4,5	5,0	5,1	4,4	
	Connection	mm	100				125			150				
Cooling Water	Temp. (inlet/outlet)	°C	32 / 37											
	Flow rate	m <sup>3</sup> /h	100	120	150	180	210	240	280	320	360	400	450	
	P. Drop	mAq	11,1	11,3	11,5	11,8	11,8	12,1	11,2	10,7	11,1	10,8	10,7	
	Connection	mm	125			150				200				250
Exhaust Gas	Temp.	kg/sec	0,88	1,05	1,32	1,58	1,84	2,11	2,46	2,81	3,16	3,51	3,95	
	Temp.	Cooling	°C 450/165											
		Heating	°C 450/125											
	P. Drop	mmAq	77	82	79	92	97	113	129	131	123	131	133	
	Outlet Conn	mm	400				500				600			
	Diverter Valve	mm	400				500				600			
Electric	Power source	-	3φ 400V 50Hz											
	Abs. Pump	kW(A)	2,0(5.7)				2,4(6.1)				3,4(9.0)			
	Ref. Pump	kW(A)	0.3(1.5)				0.4(1.6)							
	Purge Pump	kW(A)	0.4(1.4)											
	Control Pump	KVA	0.2(0.5)											
	Amp. (400 Vac)	kW(A)	2.9(9.10)				3.4(9.6)				4.4(12.5)			
Size	Length (L)	mm	2,597		3,680		3,686		4,744		4,776		4,954	
	Width (W)	mm	1,662	1,740	1,857	1,935	2,150	2,189	2,267	2,375	2,270	2,309	2,491	
	Height (H)	mm	1,979				2,303				2,470		2,744	
Weight	Rigging	mm	5,0	5,3	6,4	6,8	7,9	8,5	9,8	10,3	12,8	13,2	15,7	
	Operation	Ton	5,4	5,8	7,0	7,4	8,6	9,3	10,7	11,3	14,0	14,6	17,2	
Tube exchange space	Ton	2,400			3,400				4,500					

**Remark** Working Pressure of each water side is based on 1.0Mpu(150psig.)

Model		Unit	WEG 050	WEG 056	WEG 063	WEG 070	WEG 080	WEG 090	WEG 100	WEG 110	WEG 120	WEG 130	WEG 140	WEG 150
Cooling capacity	usRT		500	560	630	700	800	900	1000	1100	1200	1300	1400	1500
	kW		1,757	1,968	2,214	2,460	2,812	3,163	3,515	3,866	4,218	4,569	4,921	5,272
Heating capacity	Mcal/h		1416	1586	1784	1982	2266	2549	2832	3115	3398	3682	3965	4248
	kW		1646	1843	2074	2304	2633	2962	3291	3621	3950	4279	4608	4937
Chilled Water	Temp. (inlet/outlet)	°C	12 / 7											
	Flow rate	m³/h	302	339	381	423	484	544	605	665	726	786	847	907
	P. Drop	mAq	3,9	3,6	5,0	6,6	4,7	6,4	8,5	7,2	9,2	11,5	8,3	10,2
	Connection	mm	200				250			300			350	
Cooling Water	Temp. (inlet/outlet)	°C	32 / 37											
	Flow rate	m³/h	500	560	630	700	800	900	1000	1100	1200	1300	1400	1500
	P. Drop	mAq	10,8	7,7	10,6	14,0	8,7	11,8	15,6	3,0	3,8	4,8	4,0	4,9
	Connection	mm	250	300			350			400				
Exhaust Gas	Temp.	kg/sec	4,39	4,92	5,53	6,15	7,03	7,91	8,78	9,66	10,54	11,42	12,30	13,18
	Temp.	Cooling	°C	450/165										
		Heating	°C	450/125										
	P. Drop	mmAq	134	143	133	146	155	153	176	213	221	212	206	184
	Outlet Conn	mm	600	750					1000					
	Diverter Valve	mm	600	750					1000					
Electric	Power source		3φ 400V 50Hz											
	Abs. Pump	kW(A)	3,4(9,0)	5,5(14,3)					7,5(21,9)					
	Ref. Pump	kW(A)	0,4(1,6)				1,5(3,8)							
	Purge Pump	kW(A)	0,4(1,4)					0,7 (2,2)						
	Control Pump	KVA	0,2(0,5)											
	Amp. (400 Vac)	kW(A)	4,4(12,5)	6,5 (17,8)			7,6 (20,0)			9,95 (28,4)				
Size	Length (L)	mm	4,954	4,998	5,540	6,038	5,460	5,958	6,483	6,293	6,818	7,318	6,974	7,475
	Width (W)	mm	2,569	2,934	3,069	3,459	3,330	3,480	3,530	4,348	4,448	4,598	4,932	5,182
	Height (H)	mm	2,744	3,057			3,390			3,678			3,700	
Weight	Rigging	mm	16,5	21,2	23,1	24,6	31,0	33,6	35,6	41,1	43,4	46,4	50,2	54,1
	Operation	Ton	18,1	23,7	25,8	27,5	34,8	37,6	39,9	46,2	48,8	52,1	56,5	60,8
Tube exchange space	Ton	4,500		5,200	5,700	5,200	5,700	6,200	5,700	6,200	6,700	6,200	6,700	

# Multi-Fuel Absorption Chiller & Heater


100RT ~ 1000RT

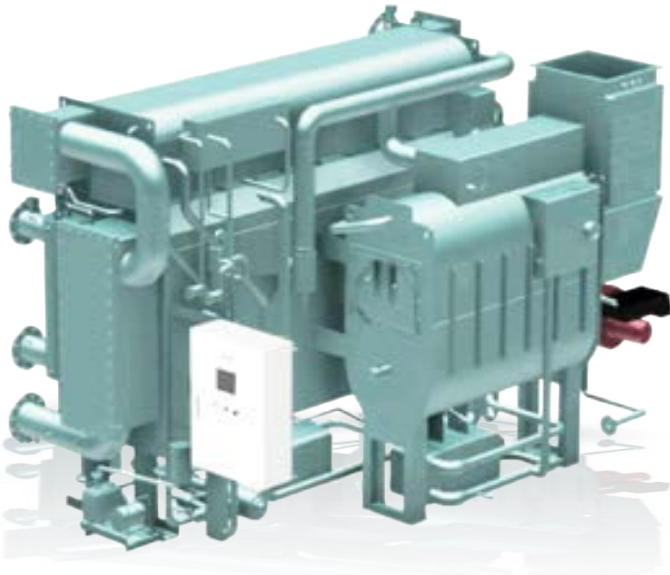

This model is designed to use different energy resource for cooling and heating. Exhaust gas, steam and hot water can be used with gas or oil.

Heat resource: Natural Gas, Oil, Steam, Hot Water


## Cycle Diagram

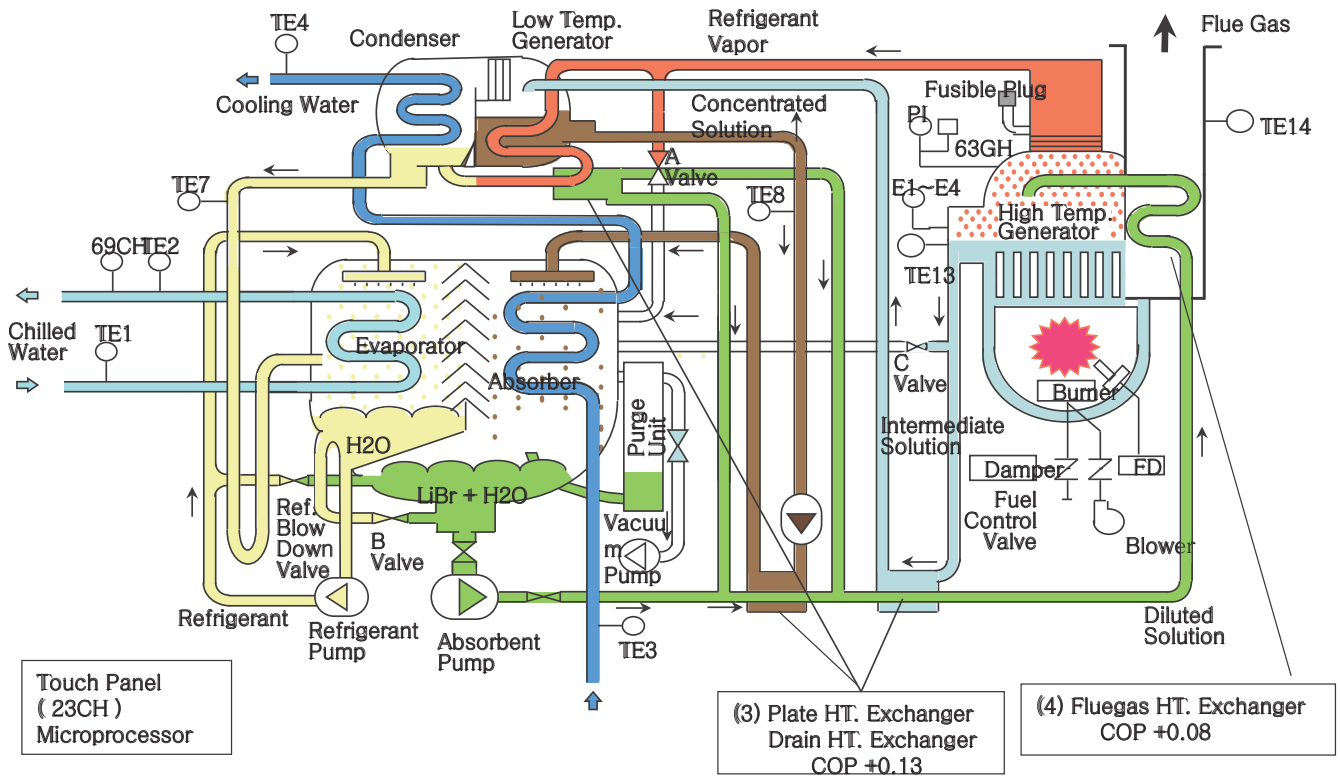


# CYCLE DIAGRAM

## Multi-Fuel Absorption Chiller & Heater

### Gas & Steam Fired (Dual Fuel)

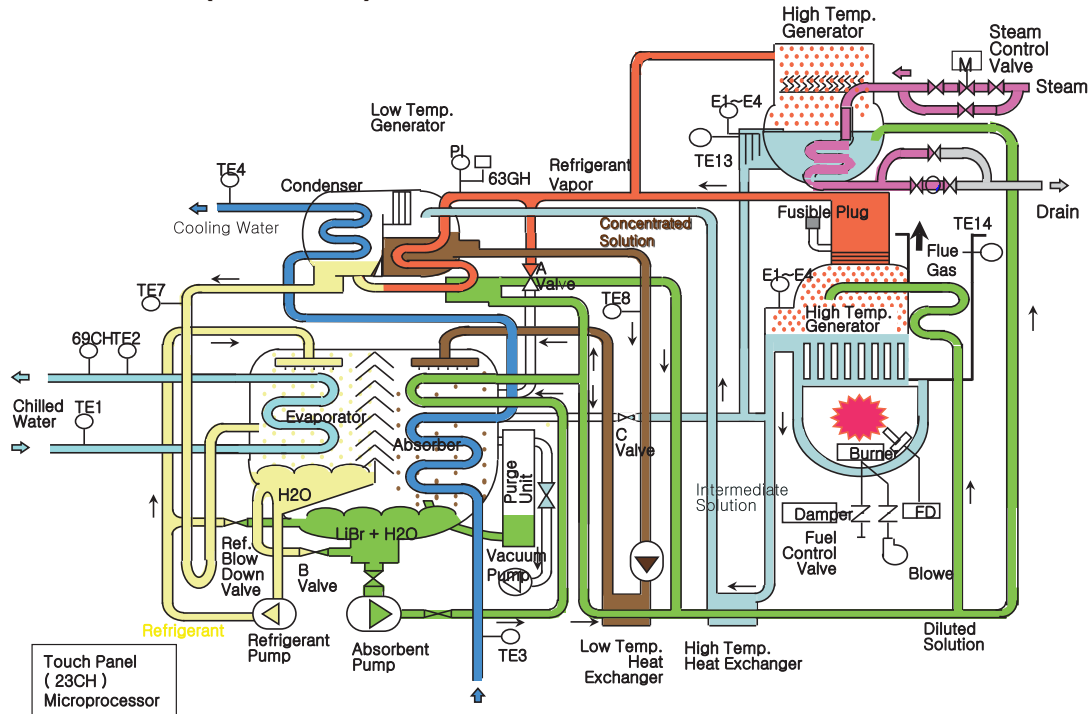

### Gas & Water Fired (Dual Fuel)

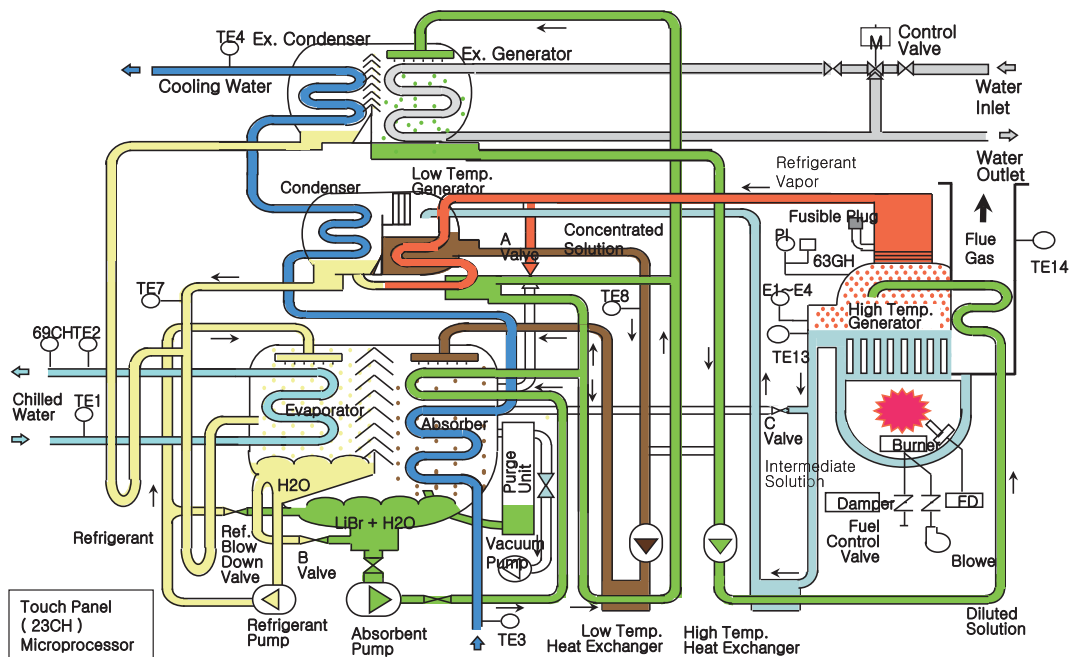


# HEAT PUMP

## ABSORPTION HEAT PUMP

Absorption Heat Pump developed to produce medium temperature energy by using high temperature energy resource such as steam, hot water and exhaust gas and low temperature waste heat energy. This Absorption Heat Pump can be used to supply hot water for heating in a building or to supply hot water in the process of factory by using waste heat resource.

### Cycle Diagram(Heated Water)

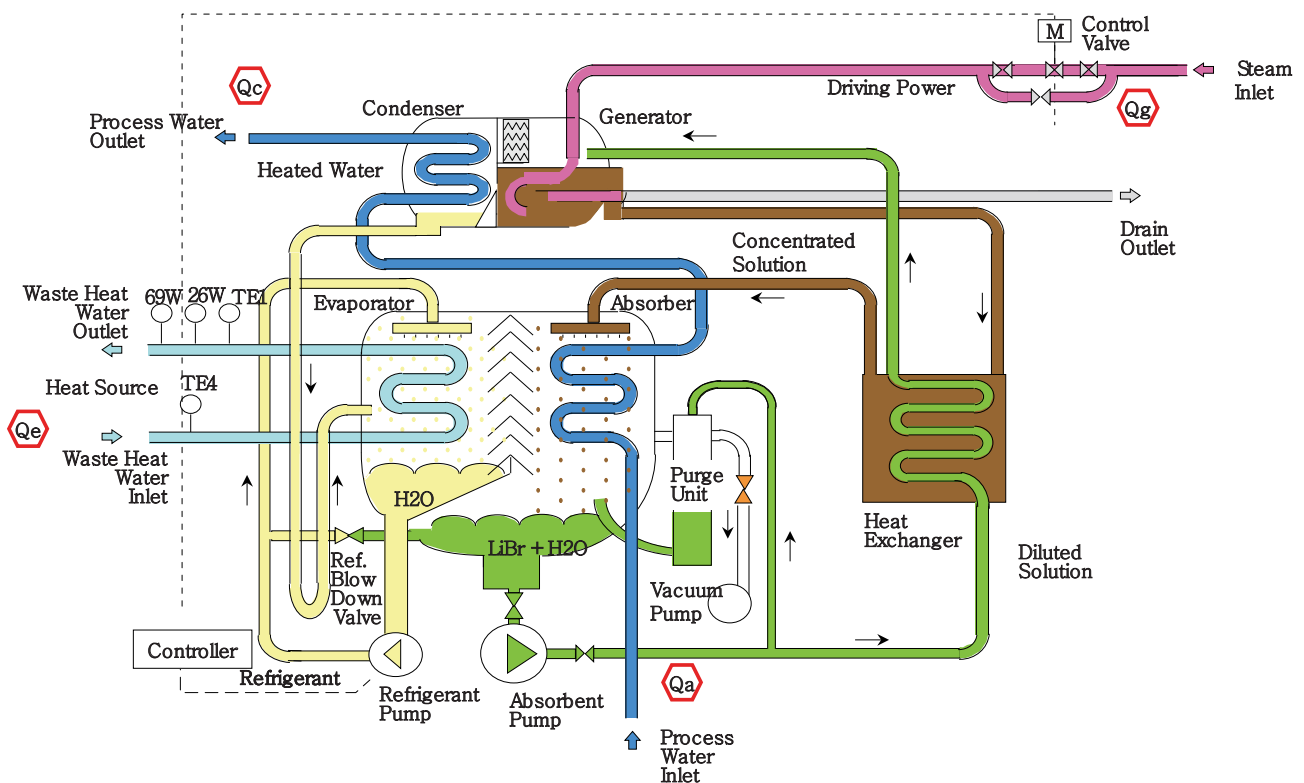

**Generator** Vapor is generated from heat supplied by driven hot water and the generated vapor is moved into Condenser.

**Condenser** The vapor is condensed on the tubes and the heat is transferred to hot water inside the tubes.

**Evaporator** The evaporator takes evaporating heat from the waste hot water and the evaporated vapor moves into Absorber.

**Absorber** The evaporated vapor is absorbed into concentrated solution coming from a generator and the heat is transferred to process hot water.




# Absorption Heat Transformer

## ABSORPTION HEAT PUMP

Absorption Heat Transformer developed to produce high temperature energy by using medium temperature energy resource in the process of factory. This Absorption Heat Transformer can be used in the plants that have high temperature waste heat resource to recycle it.

### Cycle Diagram(Steam Gene.)

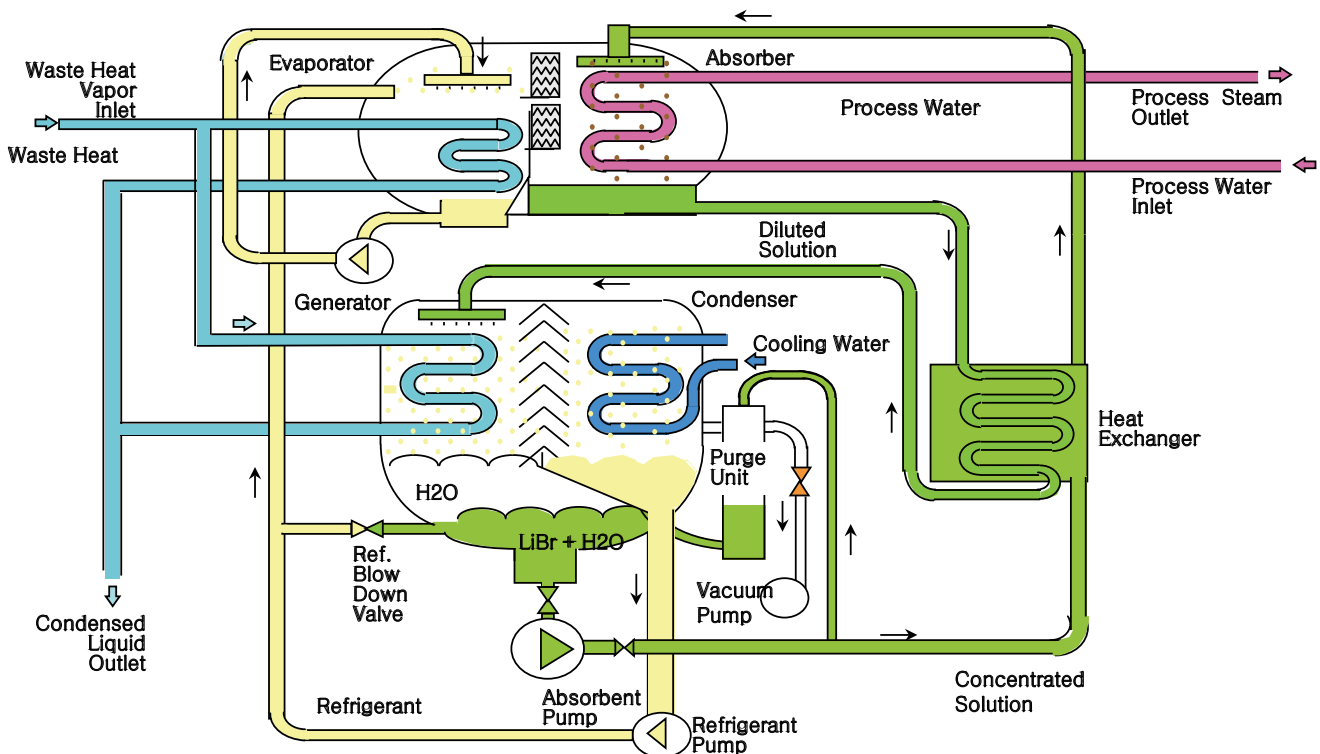

**Generator** Vapor is generated from heat supplied by driven hot water and the generated vapor is moved into Condenser.

**Condenser** The vapor is condensed on the tubes and the heat is transferred to hot water inside the tubes.

**Evaporator** The evaporator takes evaporating heat from the waste hot water and the evaporated vapor moves into Absorber.

**Absorber** The evaporated vapor is absorbed into concentrated solution coming from a generator and the heat is transferred to process hot water.

# Control System

## Care of Service Convenience & Customer Satisfaction

- Latest PLC with 10 inch touch screen, remote control and BAS compatible
- Increase chiller's efficiency with precise PID control
- Applicable for Modbus, Ethernet, BAC Net TCP/IP
- Chiller's status can be monitored through PLC Web connection (Option)

## You can have the innovative technology through WORLD EnC only

### PLC



#### Touch Screen & Color Monitor

- Control Program is composed of single-effect and double-effect
- Single-effect standard Logic : Base on Double-lift Hot Water Absorption Chiller
- Double-effect standard Logic : Base on Direct-fired Absorption Chiller and Heater
- Touch program is constructed by each model


#### Customized System

- Temperature sensor : PT1000
- Analog Input : 12 Port
- Analog Output : 4 Port
- Digital Input : 12 Port
- Digital Output : 12 Port
- RS-485C, RS-TCP/IP, VNC



- Operation history will be saved for 168 hours once every 10 seconds
- Increase the saving period up to 6 months once every 5 seconds with 2GB SD memory card (Option)
- Alarm history will be stored continuously from the initial chiller operation (unless deleted)

### Web Monitoring

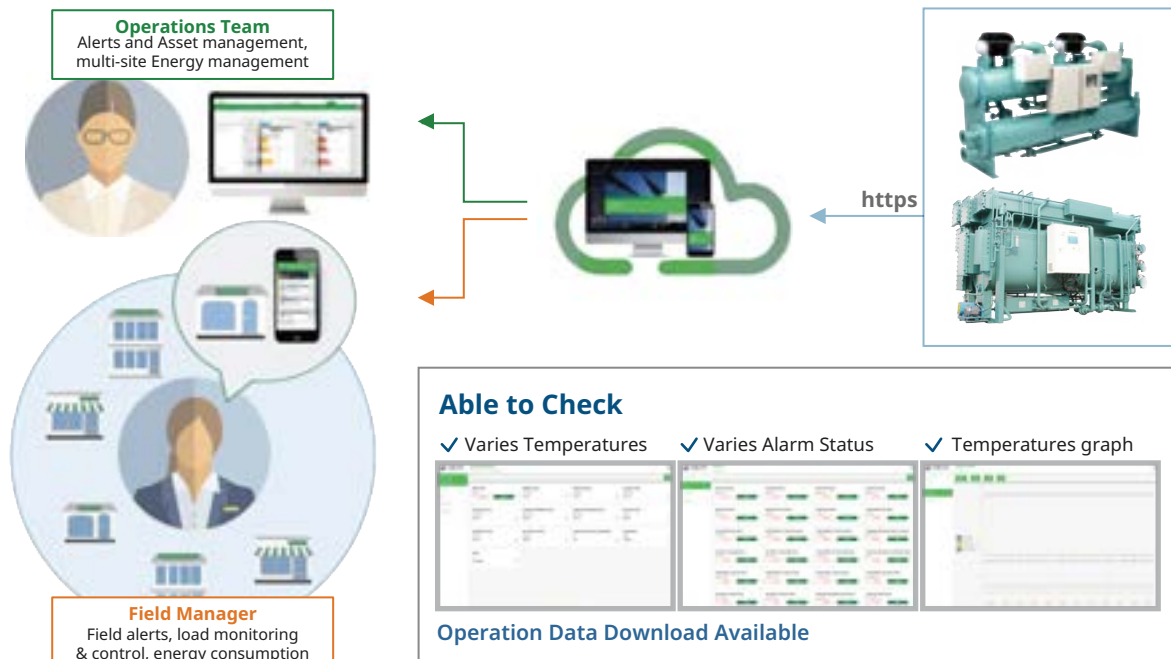

1. Possible to check real-time and past data for temperature, alarm and operation of various job sites and remotely control various set values.
2. Field and building managers use the Web Monitoring system to check and control the data for 24 hours a day, 365 days a year on PC & Mobile devices.
3. By using the Web Monitoring system, it is possible to monitor the alarm value in real-time of the chiller anywhere (work, home, even on the move), then detect abnormalities that occur during operation, and respond immediately.

# FIELD INSTALLED

World Enc

## Korea



**Government Complex in Sejong City Administrative Complex**  
Hot water / 600RT 8 units



**Incheon International Airport**  
Hot water / 975RT 8 units



**Gimpo Airport Sky Park**  
Hot water / 700RT 13 units



**Lotte Chemical Daesan Plant**  
Hot water / 1,300RT 3 units,  
975RT 1 unit



**Heungdeok IT Valley**  
Hot water / 825RT 2 units,  
270RT 2 units, 155RT



**Lotte Department Store Dongtan**  
Hot water / 820RT 10 units,  
280RT 2 units



**Pangyo Mtek Vision Office**  
Hot water / 600RT 3 units,  
340RT 10 units



**Lotte Mart Suwon Branch**  
Direct Fired / 700RT 6 units



**Lotte Chemical Yeosu Plant**  
Hot water / 525RT 2 units,  
Steam 1100RT



**Korea Zinc Onsan Refinery**  
Steam / 500RT 2 units



**Inha University Hospital**  
Direct Fired / 800RT 4 units



**Dongtan Hallym University Hospital**  
Hot water / 900RT 2 units

# FIELD INSTALLED

World Enc

## Korea



**Galleria Department Store  
Gwanggyo**  
Hot water / 750RT 6 units, 190RT 2 units



**Songdo Landmark Prugio City**  
Hot water / 600RT 2 units,  
400RT units, 200RT units



**Magok Genexine Handok RND Center**  
Hot water / 600RT 2 units,  
380RT 2 units, 135 / 110RT



**Changdong Station Cultural  
Industrial Complex**  
Direct Fired / 560RT 4 units



**Gwangmyeong Lotte Outlet**  
Hot water / 600RT 7 units,  
135RT 2 units



**Homeplus Sosa**  
Direct Fired / 600RT 5 units



**Homeplus Suwon Homesil**  
Hot water / 600RT 2 units



**E-Mart (Paju Unjeong / Asan Baebang)**  
Hot water / 575RT 2 units,  
525RT 2 units



**Lakeside Gwanggyo Residential Complex**  
Hot water / 675RT 2 units,  
525RT 2 units



**Lotte Songdo Residential Complex**  
Hot water / 470RT 2 units,  
340RT 4 units



**Lotte Cheongna Residential Complex**  
Direct Fired / 500RT 2 units



**POSCO Gwanggyo Residential Complex**  
Hot water / 525RT 3 units,  
135RT 2 units

**Italy / Mexico / Germany**




**New Treviso Hospital in Italy**  
Hot water / 420RT 1 unit



**Pordenone Hospital in Italy**  
Hot water / 210RT 2 units



**IBI Pharmaceutical Spa in Italy**  
Hot water / 180RT 1 unit

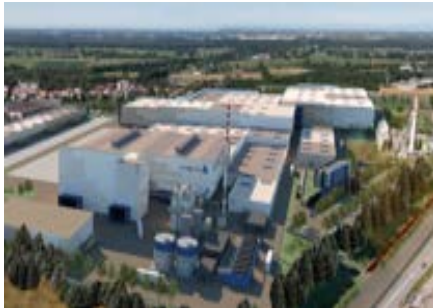

**Vetropack in Italy**  
Hot water / 155RT 2 units



**FOE HOTEL ALBA in Italy**  
Hot water / 135RT 1 unit



**SYMBIOSIS MILANO in Italy**  
Hot water / 75RT 1 unit



**Hotel in Brescia in Italy**  
Hot water / 75RT 1 unit



**Catapult Factory in Mexico**  
Hot water / 110RT 1 unit



**HEWMEG in Germany**  
Hot water / 900RT 1 unit,  
600RT 2 units



**3M - Hilden in Germany**  
Hot water / 240RT 1 unit



**Militeny Biotec in Germany**  
Hot water / 90RT 2 units



**Tornow in Germany**  
Hot water / 75RT 1 unit

# FIELD INSTALLED

World Enc

## Poland / Iran / Pakistan



**JEDRUS in Poland**  
Hot water / 90RT 2 units



**Hospital Trigen in Poland**  
Hot water / 60RT 2 units



**PGNiG in Poland**  
Direct Fired / 180RT 1 unit



**Żołyńia in Poland**  
Direct Fired / 60RT 2 units



**Lexon Tower in Iran**  
Direct Fired / 630RT 2 units



**Bahar Hospital in Iran**  
Steam Fired / 500RT 2 units



**Tehran Hospital in Iran**  
Direct Fired / 360RT 1 unit



**R&D Center in Iran**  
Direct Fired / 240RT 1 unit



**NEE in Pakistan**  
Direct Fired / 1400RT 2 units



**PSPC/SPC in Pakistan**  
Direct Fired / 500RT & 360RT



**Karachi Hospital in Pakistan**  
Hot water / 375RT 1 unit



**Hotel OA in Pakistan**  
Hot water / 240RT 1 unit

# I MEMO

A series of horizontal dashed lines for writing a memo.



www.worldenc.com



www.barismuhendislik.com.tr



www.enerkonmuhendislik.com.tr



**H.Q & Factory** 102, Dolseoji-gil, Jangan-myeon, Hwaseong-si, Gyeonggi-do, Korea

**Sales Office** Digital Empire B-dong 1207-ho, 383, Simin-daero, Dongan-gu, Anyang-si, Gyeonggi-do, Korea

**Tel:** +82-70-4099-7559 **Fax:** +82-31-8066-5230



**H.Q & Factory** Adana Organize Sanayi Bölgesi, Magarsuz Caddesi, No:8 Adana/Türkiye

**Tel:** +90 (322) 456 14 14 **E-mail:** info@barismuhendislik.com.tr

**Istanbul Office** Barbaros mahallesi. Halk Caddesi Palladium Residence A Blok No: 8A/3 Ataşehir/Istanbul

**Tel:** +90 (216) 663 11 04